


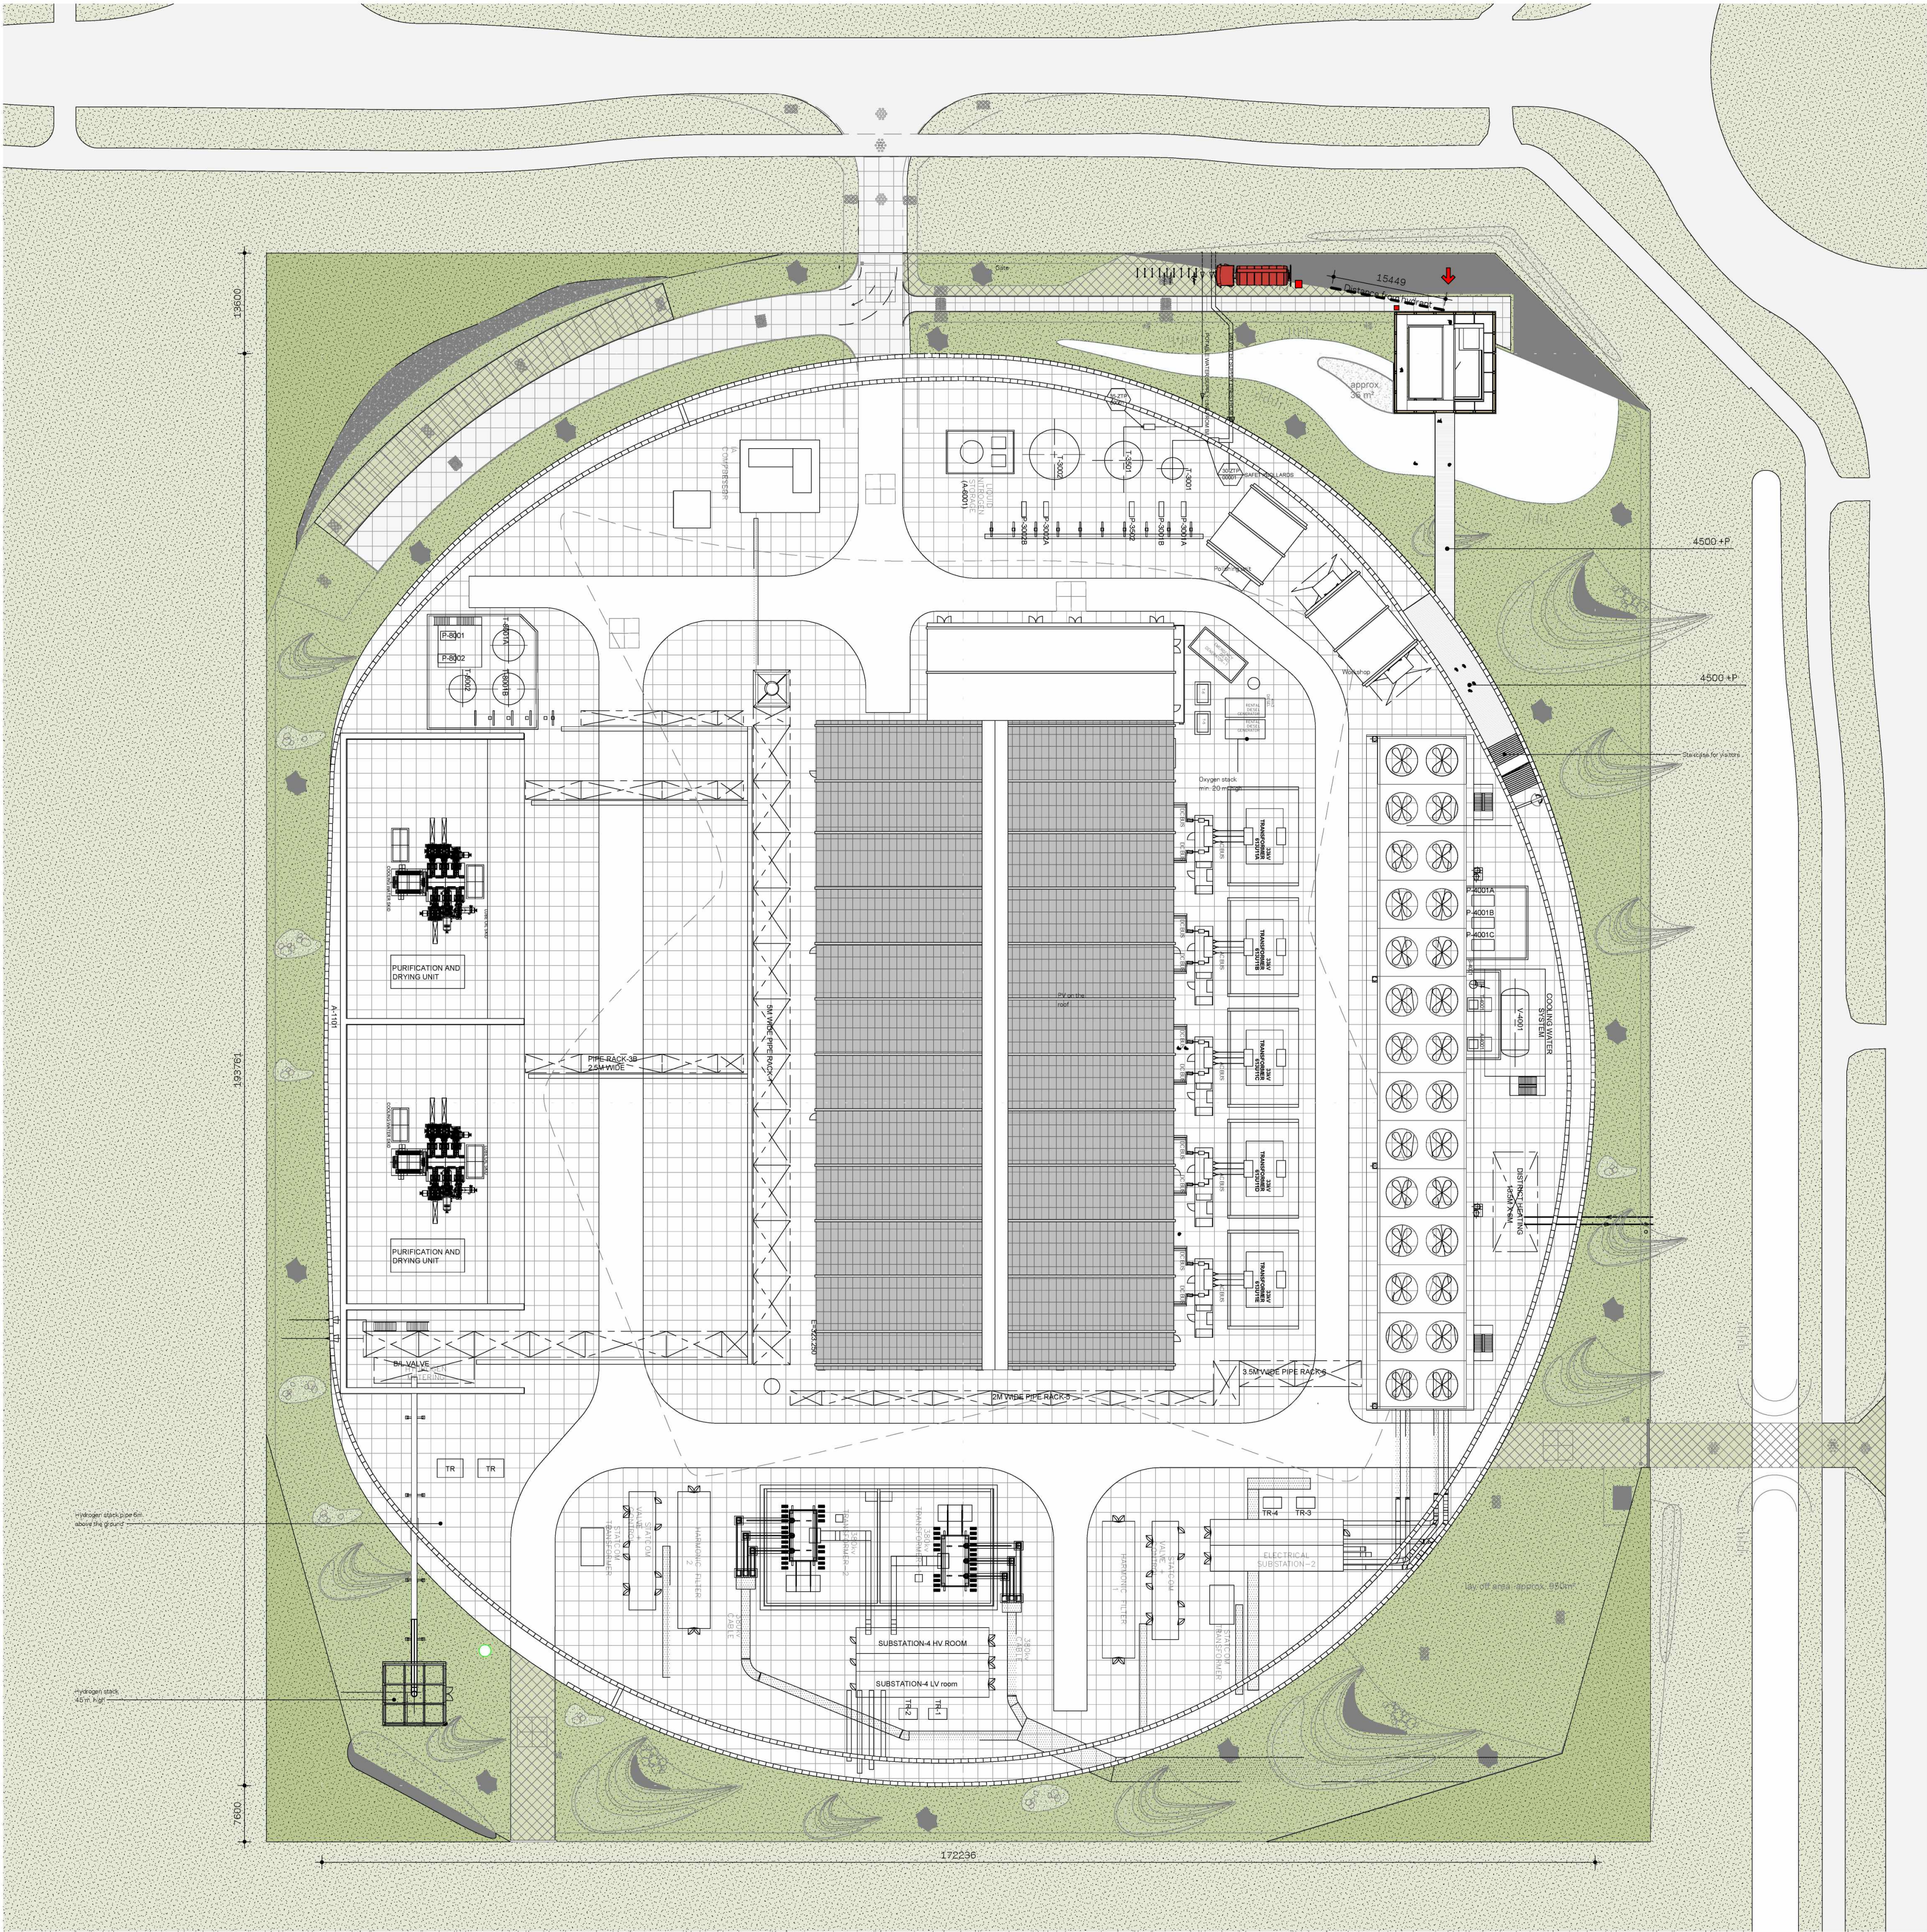

Renvooi

- Lift 5.0 m2
- naam ruimte
- oppervlakte
- draagconstructie
- bouwkundige invulling nog nader te bepalen
- systeemwand
- brandweerlift
- pictogram met de vluchtrichting
- pictogram voor normale uitgang die ook als nooduitgang kan worden gebruikt
- ruimte voorzien van noodverlichting
- ruimte voorzien van branddetectie
- brandweerpaneel
- brandmeldcentrale
- alarmhoorn (slowhoop)
- sleutelkuis
- kleefmagneet of dranger met vastzetinrichting
- aansluiting droge blusleiding
- draagbaar blus toestel
- vluchtrichting
- 30 - - - - 30 30 minuten brandwerend.
- 30 - - - - 30 30 minuten brandwerend en Ra rookwerend.
- 30 - - - - 30 30 minuten brandwerend en R200 rookwerend.
- 60 - - - - 60 60 minuten brandwerend.
- 60 - - - - 60 60 minuten brandwerend en Ra rookwerend.
- 60 - - - - 60 60 minuten brandwerend en R200 rookwerend.
- 90 - - - - 90 90 minuten brandwerend.
- 90 - - - - 90 90 minuten brandwerend en Ra rookwerend.
- 90 - - - - 90 90 minuten brandwerend en R200 rookwerend.
- 30 minuten zelfsluitende brandwerende deur met kozijn inclusief zij- en / of bovenlicht. (WBDBO 30). dagmaat minimaal 900 mm.
- 60 minuten zelfsluitende brandwerende deur met kozijn inclusief zij- en / of bovenlicht. (WBDBO 60). dagmaat minimaal 900 mm.
- zelfsluitende niet-brandwerende deur

waterdichtheid

- uitwendige scheidingsconstructies zijn waterdicht conform NEN 2778;
- scheidingsconstructies tussen verblijfsgebied en kruipruimten zijn waterdicht conform NEN 2778;
- scheidingsconstructies rondom toilet ruimtes zijn waterdicht conform NEN 2778;

luchtdoorlatendheid

- de volgens NEN 2686 bepaalde luchtvolumestroom van het totaal aan verblijfsgebieden en toilet ruimtes van de gebruiksfuncties is niet groter van 0,2 m3/s
- de scheidingsconstructies tussen verblijfsgebieden, toilet ruimtes en kruipruimten, met inbegrip van de op die constructie aansluitende delen van andere constructies, voorzover die delen van invloed zijn op de specifieke luchtvolumestroom naar het verblijfsgebied of toilet ruimte heeft volgens NEN 2686 bepaalde, specifieke luchtvolumestroom van ten hoogste 20*10-6 m3/(m2*s)

gevelopeningen

- Gevel voorzien van muisdichte roosters. Gevelopeningen niet groter dan 1 cm2.

wateropname

- scheidingsconstructies rondom toiletten hebben een wateropname die gemiddeld <0,01 kg/(m2 *S1/2) en op geen enkele plaats >0,2 kg/(m2*S1/2)

brandveiligheid

vluchtroute (vluchtweg en trappenhuis)

- materialen toegepast in deze ruimte voldoen aan brandklasse B en rookklasse S2 (NEN-EN 13501 of gelijkwaardige klassen conform Nederlandse NEN-normen).
- trap cq. vloerafwerkingen voldoen aan brandklasse Cfl en rookklasse S1fl (NEN-EN 13501 of gelijkwaardige klassen conform Nederlandse NEN-normen).
- brandhydrant: positie en capaciteit nog ntb en vast te stellen door gemeente, brandweer en watersiedingmestochtoppij normen).

overige inpendige ruimtes

- materialen toegepast in de vloer van deze ruimtes voldoen aan brandklasse Dfl en rookklasse S1fl (NEN-EN 13501 of gelijkwaardige klassen conform Nederlandse NEN-normen).

gevelconstructies:

- gevelconstructies voldoen aan brandvoortplantingsklasse 1, tot 2,5 meter boven aansluitend terrein en brandvoortplantingsklasse 2 (rest van de gevel)(NEN 6065).
- overige materialen toegepast in deze ruimtes voldoen aan brandklasse D en rookklasse S2 (NEN-EN 13501 of gelijkwaardige klassen conform Nederlandse NEN-normen).

dak:

- het dak is niet brandgevaarlijk conform NEN 6063

opmerkingen:

- constructieafmetingen volgens opgave constructeur
- installaties volgens opgave installatieadviseur
- de verdeling van glas van de binnenruiten zal dusdanig zijn dat aan eisen brandwerendheid voldaan wordt; (nb. binnenkozijnen van hout >550 kg/m3 cq. plaatstaal cq. staal)
- binnendeuren die zich in een vluchtroute bevinden, zijn niet voorzien van een dag- en nachtlot
- inbraakwerendheidsklasse 2 volgens NEN 5096

Legend

- Elevator 5.0 m2
- room name
- area
- load-bearing structure
- architectural infill to be determined
- system wall
- fire elevator
- pictogram showing direction of escape
- pictogram for normal exit which can also be used as an emergency exit
- room equipped with emergency lighting
- room equipped with fire detection
- fire panel
- fire alarm control unit
- alarm horn (slowhoop)
- key safe
- adhesive magnet or closer with hold-down device
- dry riser connection
- portable fire extinguisher
- escape direction
- 30 - - - - 30 30 minutes fire resistant.
- 30 - - - - 30 30 minutes fire resistant and Ra smokeproof.
- 30 - - - - 30 30 minutes fire resistant and R200 smokeproof.
- 60 - - - - 60 60 minutes fire resistant.
- 60 - - - - 60 60 minutes fire resistant and Ra smokeproof.
- 60 - - - - 60 60 minutes fire resistant and R200 smokeproof.
- 90 - - - - 90 90 minutes fire resistant.
- 90 - - - - 90 90 minutes fire resistant and Ra smokeproof.
- 90 - - - - 90 90 minutes fire resistant and R200 smokeproof.
- 30 minutes self-closing fire-resistant door with frame including side and/or top light. (WBDBO 30). Day/light size at least 900 mm.
- 60 minutes self-closing fire-resistant door with frame including side and/or top light. (WBDBO 60). Day/light size at least 900 mm.
- self-closing non-combustible door

waterproofness

- External partition constructions are watertight in accordance with NEN 2778;
- Partitioning structures between the occupied area and crawl spaces are watertight in accordance with NEN 2778;
- Partitioning structures around toilet areas are watertight in accordance with NEN 2778;

air permeability

- the air volume flow of the total of the domestic areas and toilet areas of the functions of use determined in accordance with NEN 2686 does not exceed 0.2 m3/s
- the partition constructions between domestic areas, toilet areas and crawl spaces, including the parts of other constructions connected to that construction, insofar as those parts influence the specific air volume flow to the domestic area or toilet area, has a specific air volume flow of at most 20*10-6 m3/(m2*s), determined in accordance with NEN 2690

facade openings

- Facade provided with mouse-proof grilles. Gable openings no larger than 1 cm2.

water absorption

- partition structures around toilets have a water absorption of <0,01 kg/(m2*S1/2) on average and >0,2 kg/(m2*S1/2) at no point)

fire safety

escape route (escape route and staircase)

- materials applied in this space comply with fire class B and smoke class S2 (NEN-EN 13501 or equivalent classes in accordance with Dutch NEN standards).
- staircase or floor finishes comply with fire class Cfl and smoke class S1fl (NEN-EN 13501 or equivalent classes in accordance with Dutch NEN standards).
- fire hydrant: position and capacity not yet known and to be determined by the municipality, fire brigade and water supply company standards).

other indoor spaces

- materials used in the floors of these areas comply with fire class Dfl and smoke class S1fl (NEN-EN 13501 or equivalent classes according to Dutch NEN standards).

facade structures

- facade constructions comply with fire propagation class 1, up to 2.5 metres above adjoining grounds) and fire propagation class 2 (rest of the facade)(NEN 6065).
- other materials applied in these areas comply with fire class D and smoke class S2 (NEN-EN 13501 or equivalent classes according to Dutch NEN standards).

roof

- the roof does not constitute a fire hazard according to NEN6063

comments

- construction dimensions as specified by the constructor
- installations as per installation advisor's specifications
- The distribution of glass of the inner facades will be such that the fire resistance requirements are met; (nb. inner frames of wood >550 kg/m3 or sheet steel or steel)
- inner doors located in an escape route are not fitted with a day and night lock.
- burglary resistance class 2 according to NEN 5096

Roofplan	
project	HH1
werk.nr	3258 01
tek.nr. KA	PG-02-500
tek.nr. WR	NL8905/A 01/0002
tek.nr. SH	HH1-1000-CB-2307-0002
datum	21-04-2022
schaal	1:500 A1
status	Definitive
revisie	16-05-2022
fase	