
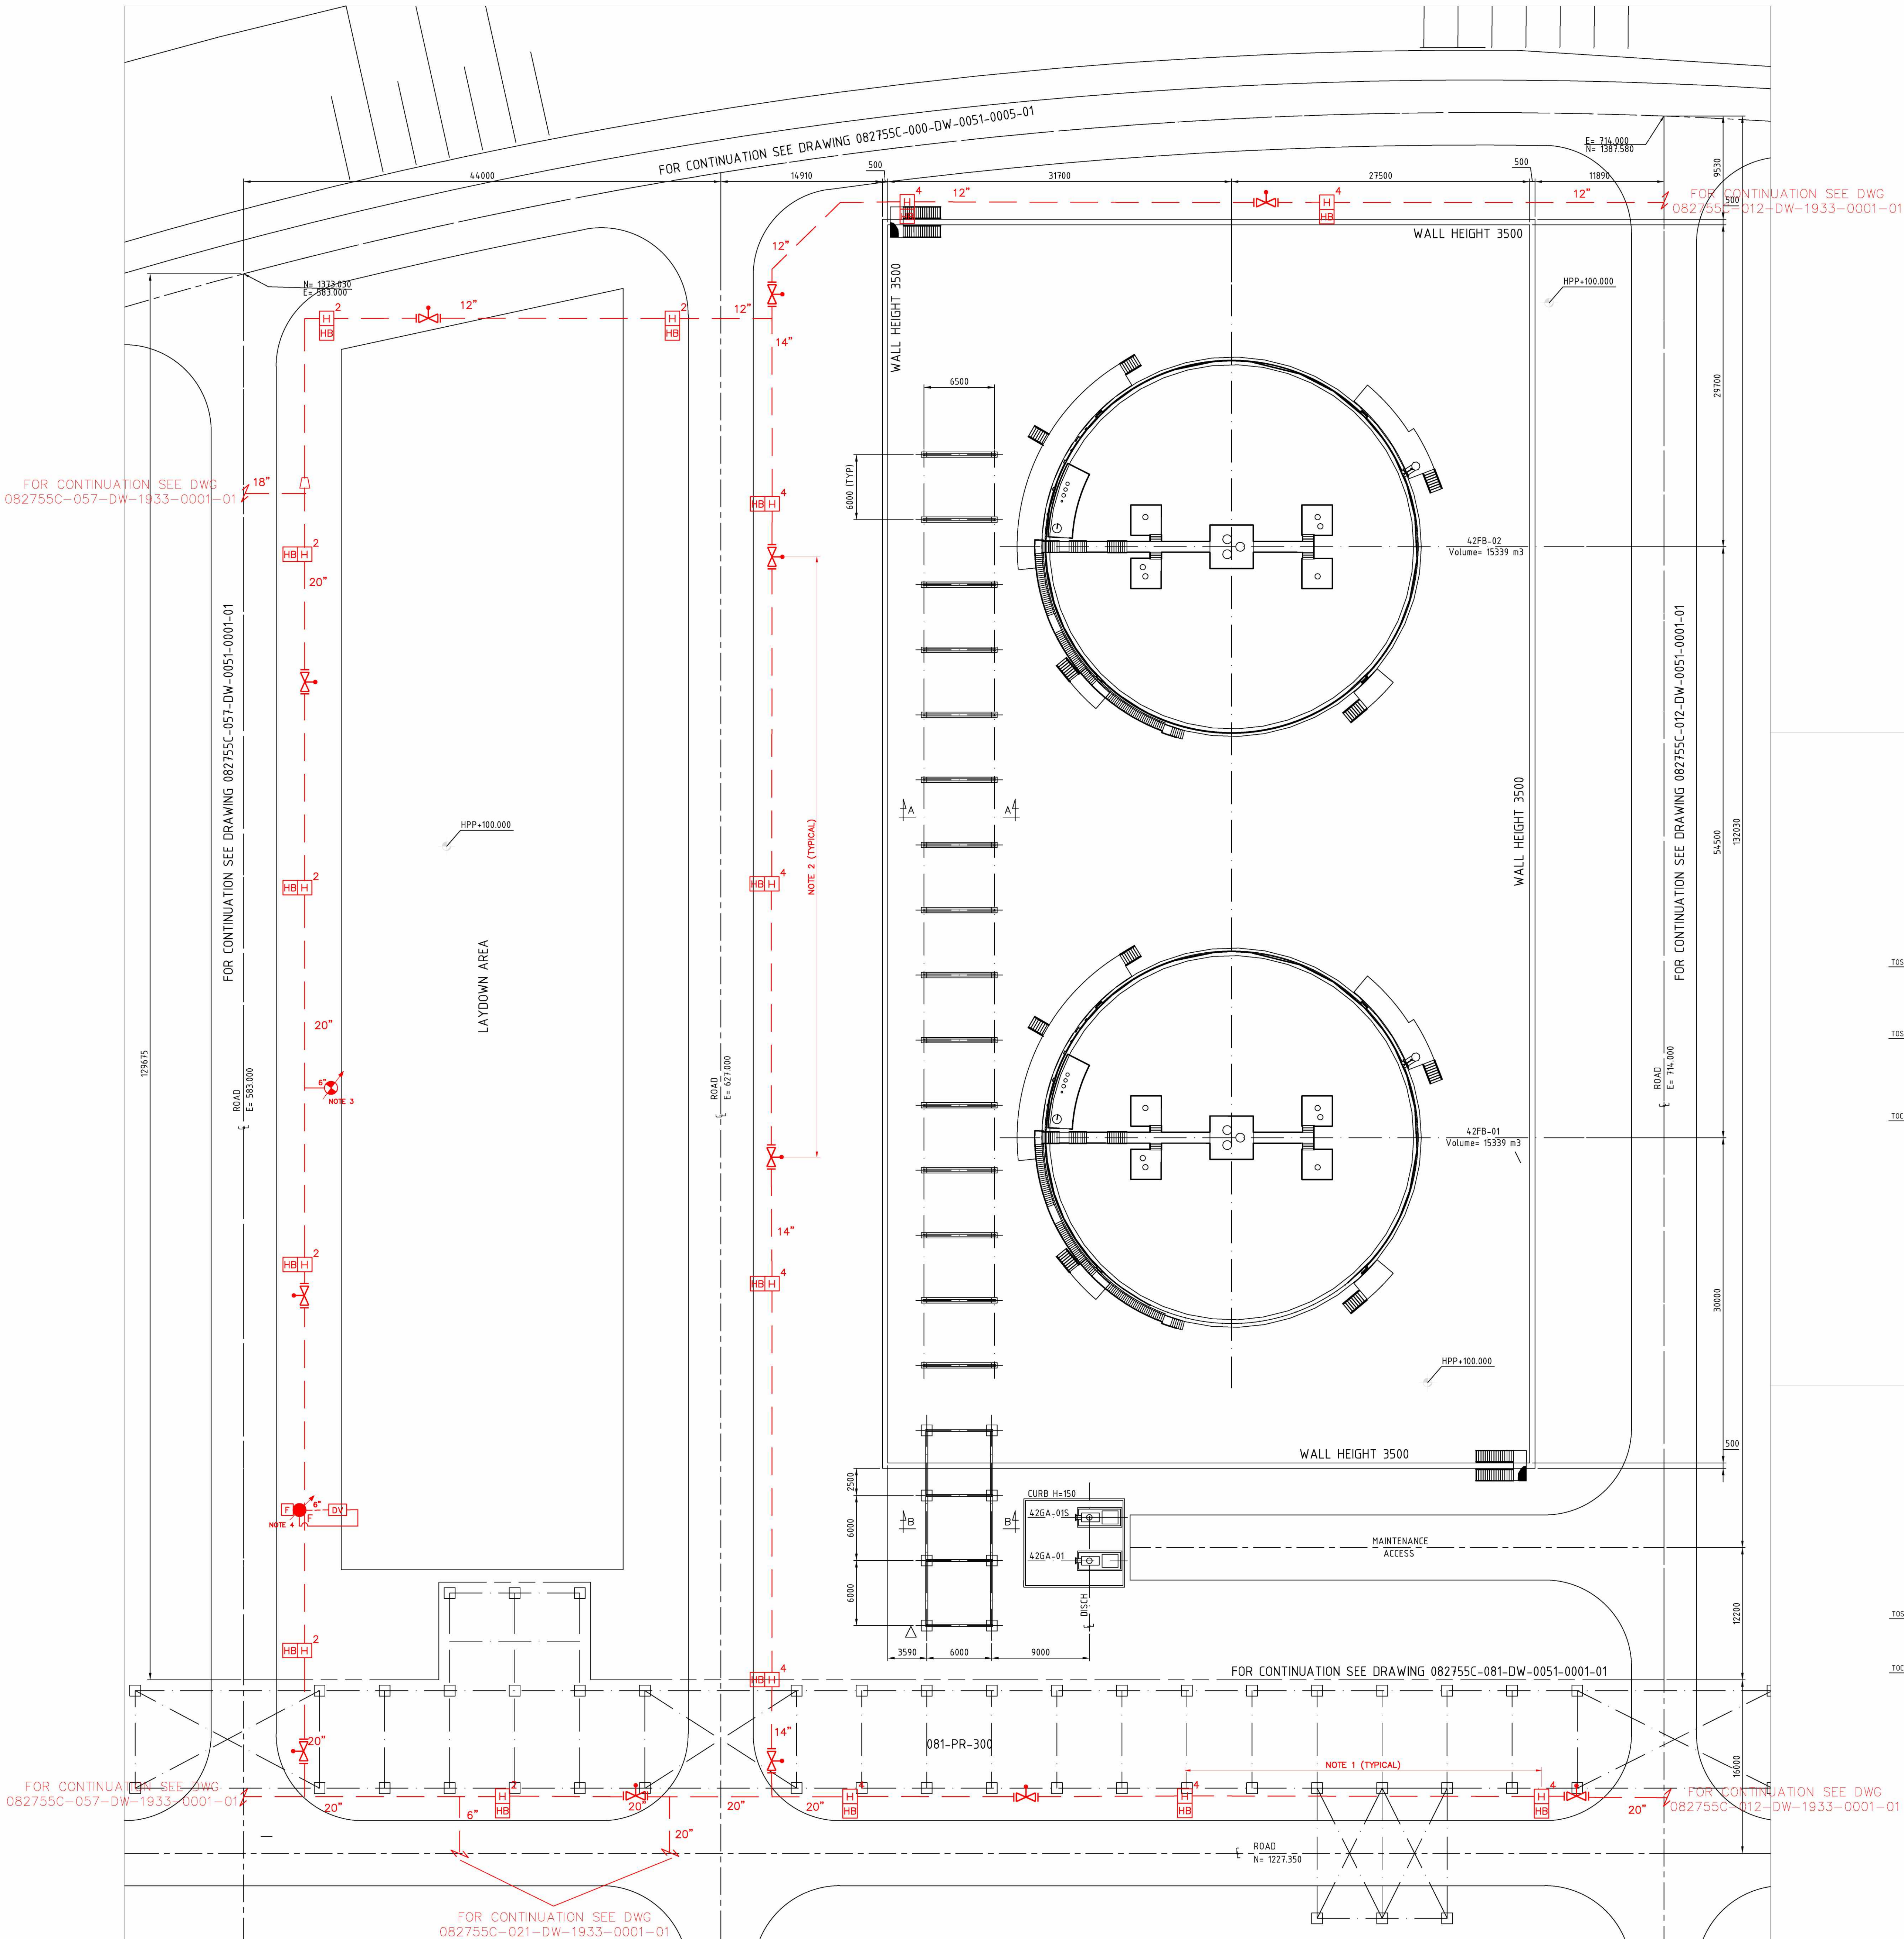


The present document or drawing is property of TECHNIP ITALY S.p.A. and shall not, under any circumstances, be totally or partially, directly or indirectly, transferred, reproduced, copied, disclosed or used, without its prior written consent, for any purpose and in any way other than that for which it is specifically furnished or outside the extent of the agreed upon right of use.

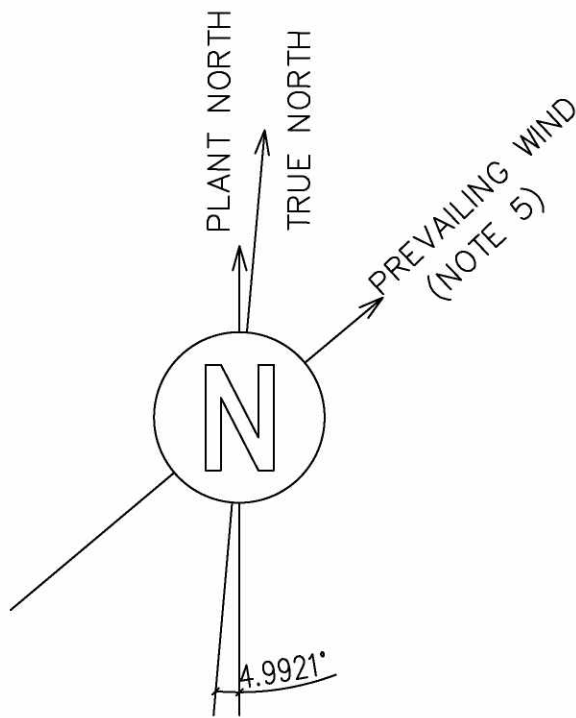

EQUIPMENT NO.	SERVICE	NOTE
42FB-01	INTERMEDIATE TANK	
42FB-02	INTERMEDIATE TANK	
42GA-01/S	NEXBTL2 UNIT FEED PUMPS	
42GD-01A/B	TANK MIXER	INSIDE 42FB-01
42GD-02A/B	TANK MIXER	INSIDE 42FB-02
42EB-01	42FB-01 HEATING COIL	NOT SHOWN ON PLOT PLAN
42EB-02	42FB-02 HEATING COIL	




GENERAL NOTES
A. FOR DETAILS ON ACTIVE FIRE PROTECTION REFER TO "ACTIVE FIRE PROTECTION PHILOSOPHY" (082755C-000-JSD-1900-0001).
B. HYDRANT CONNECTION TO FIREWATER MAIN RING IS 6".

NOTES
1. MAXIMUM DISTANCE BETWEEN TWO HYDRANTS SHALL NOT EXCEED 40 METERS.
2. MAXIMUM DISTANCE OF PIPING BETWEEN TWO PVS SHALL BE NO MORE THAN 60 METERS AND SUCH THAT NO MORE THAN THREE FIRE PROTECTION DEVICES (MONITORS, HYDRANTS, FIXED SPRAY SYSTEM) ARE OUT OF SERVICE.
3. WATER MONITOR INSTALLED FOR UNIT 11 PROTECTION.
4. REMOTE CONTROL FOAM-WATER MONITOR INSTALLED FOR UNIT 11 PROTECTION.

LEGEND

SYMBOLS	DESIGNATION	QTY
	TWO WAY HYDRANT	7
	FOUR WAY HYDRANT	9
	HOSE BOX (HB)	16
	HYDRANT WITH MONITOR	0
	WATER MONITOR (WM)	1
	ELEVATED REMOTE CONTROL WATER MONITOR (EWM)	0
	REMOTE CONTROL WATER MONITOR WITH TOWER (TWM)	0
	REMOTE CONTROL FOAM-WATER MONITOR (FWM)	1
	FOAM-WATER MONITOR	0
	FOAM CONTAINER	1
	DRY RISING MAIN WITH BREACHING INLET CONNECTION (DR)	0
	HOSE REEL (HR)	0
	DELUGE VALVE (DV)	1
	GATE VALVE POST INDICATOR (PI)	13
	FIXED SPRAY SYSTEM	0
	FIRE WATER U/G LINE	NOT APPLICABLE
	FIRE WATER A/G LINE	NOT APPLICABLE

DO NOT USE AS PLOT PLAN VALID FOR FIREFIGHTING ONLY

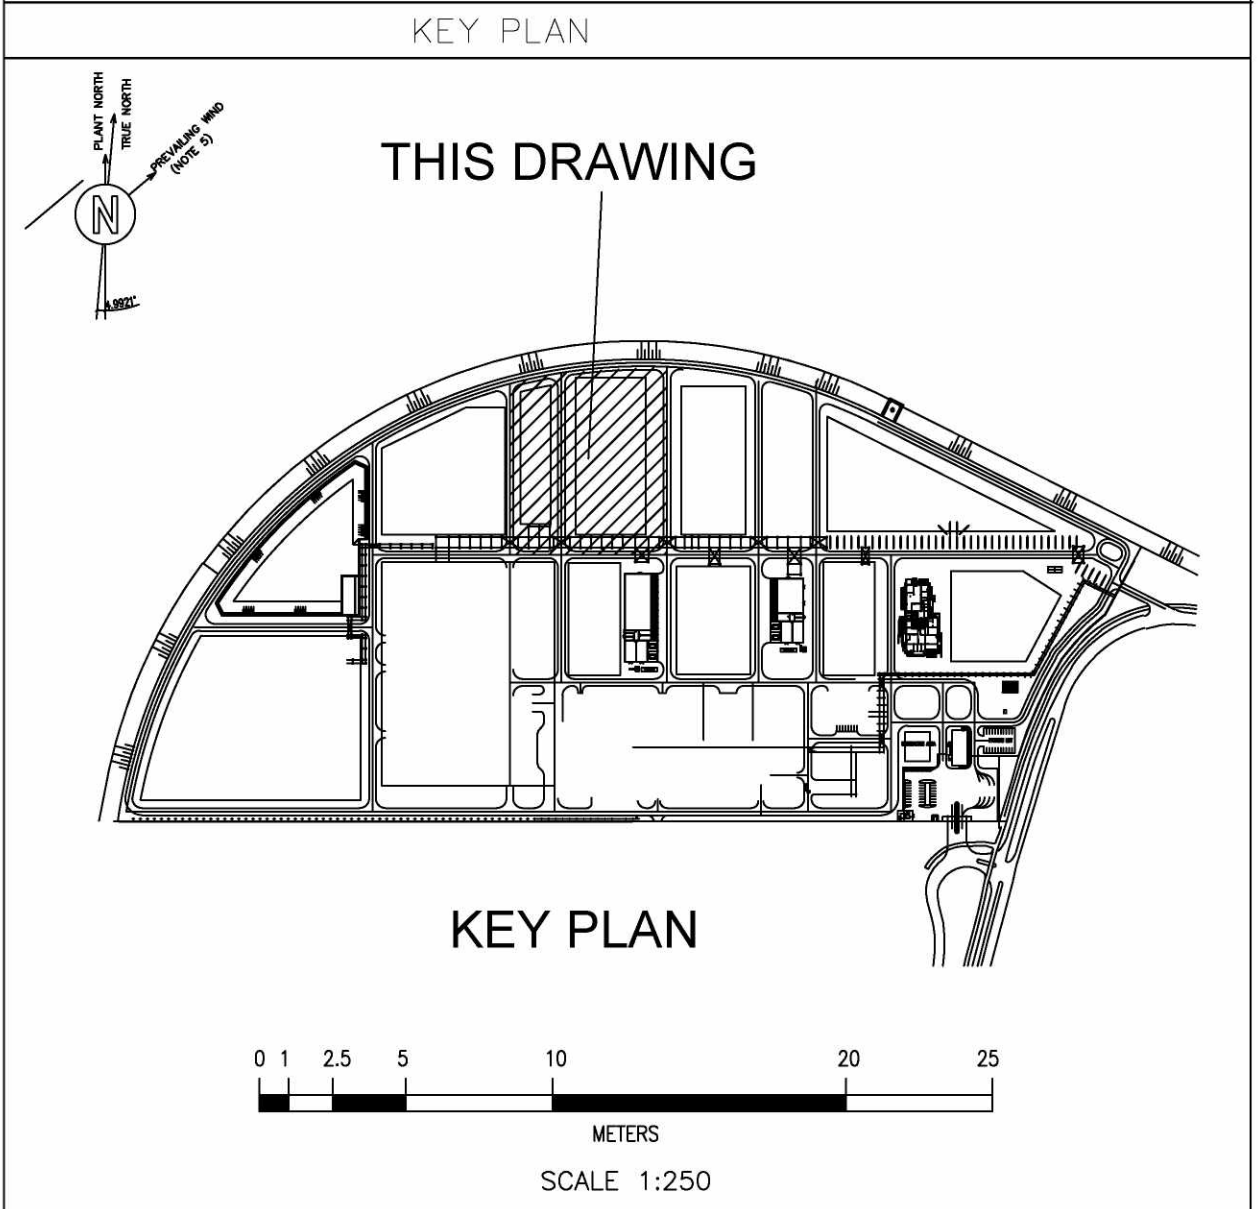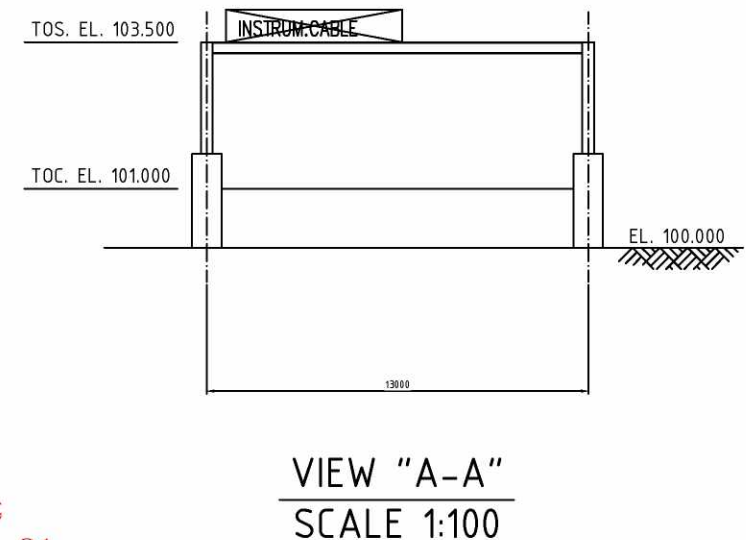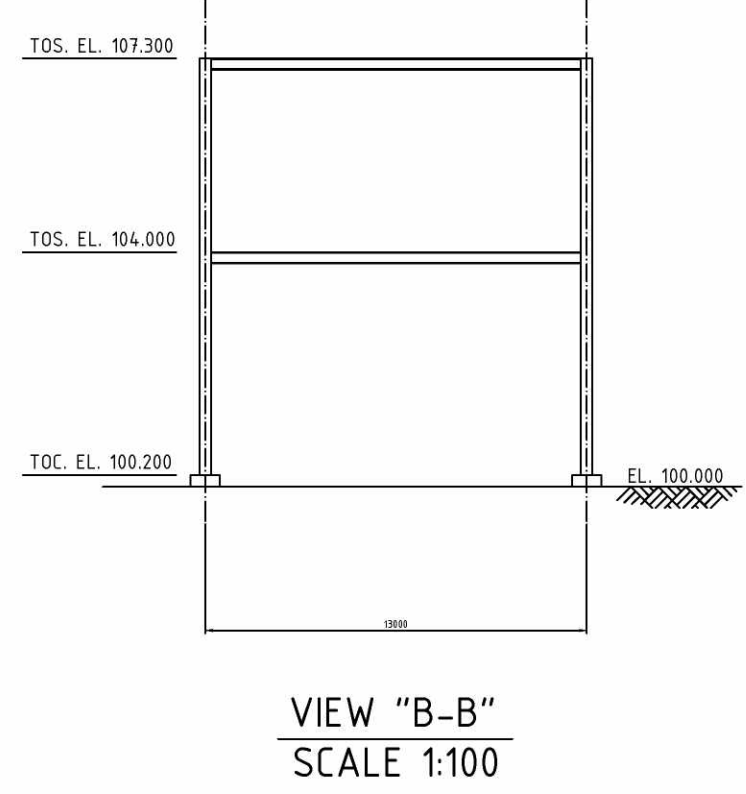

082755C-042-DW-0001-0001-01_B		042 (TANK FARM MNA) – UNIT PLOT PLAN				
Drawing No		DESCRIPTION				
REFERENCE DRAWINGS						
CONFIDENTIAL						
2-9-2021	Issued for local authorities				 Technip Energy Services	
A	11/05/2021	ISSUE FOR REVIEW	C.POGGI	A.TAMBURRO	 Technip Energy Services	
REV	DATE	DESCRIPTION	PREP	CKD	APPR/AUTH	
			 TECHNIP ENERGIES			
RDCG (Rotterdam Capacity Growth) - DEFINITION PHASE						
NESTE						
DETAILED FIREFIGHTING LAYOUT – UNIT 042						
Scale	Technip Drawing No				Page	Rev.
1/250	082755C Project	042 Unit	DW Doc.Type	19 33 Disc Ser.No	0001 1of1	A
NESTE Drawing No						
- CAD Model						