
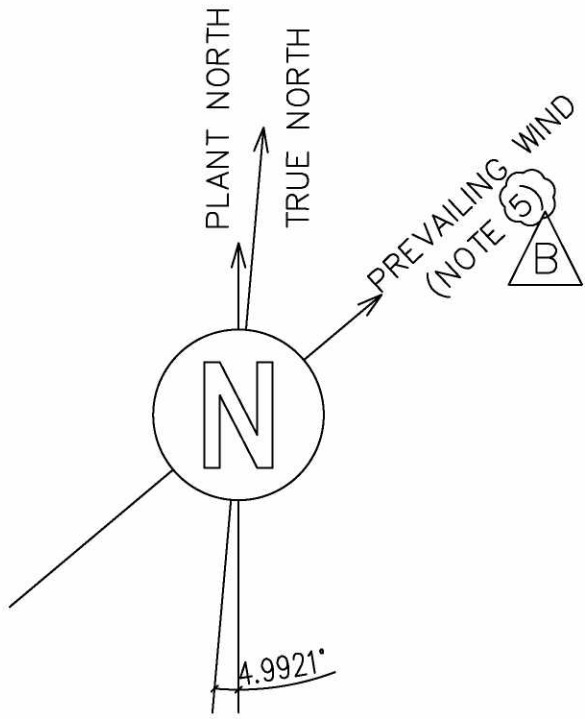



The present document or drawing is property of TECHNIP ITALY S.p.A. and shall not, under any circumstances, be totally or partially, directly or indirectly, transferred, reproduced, copied, disclosed or used, without its prior written consent, for any purpose and in any way other than that for which it is specifically furnished or outside the extent of the agreed upon right of use.

EQUIPMENT NO.	SERVICE	NOTE
62AD-03	SANITARY WATER BASIN	
62GA06/S	SANITARY WATER PUMPS	
076-1A-10	OPERATION BUILDING, LABORATORY AND SS-14 (MNA)	

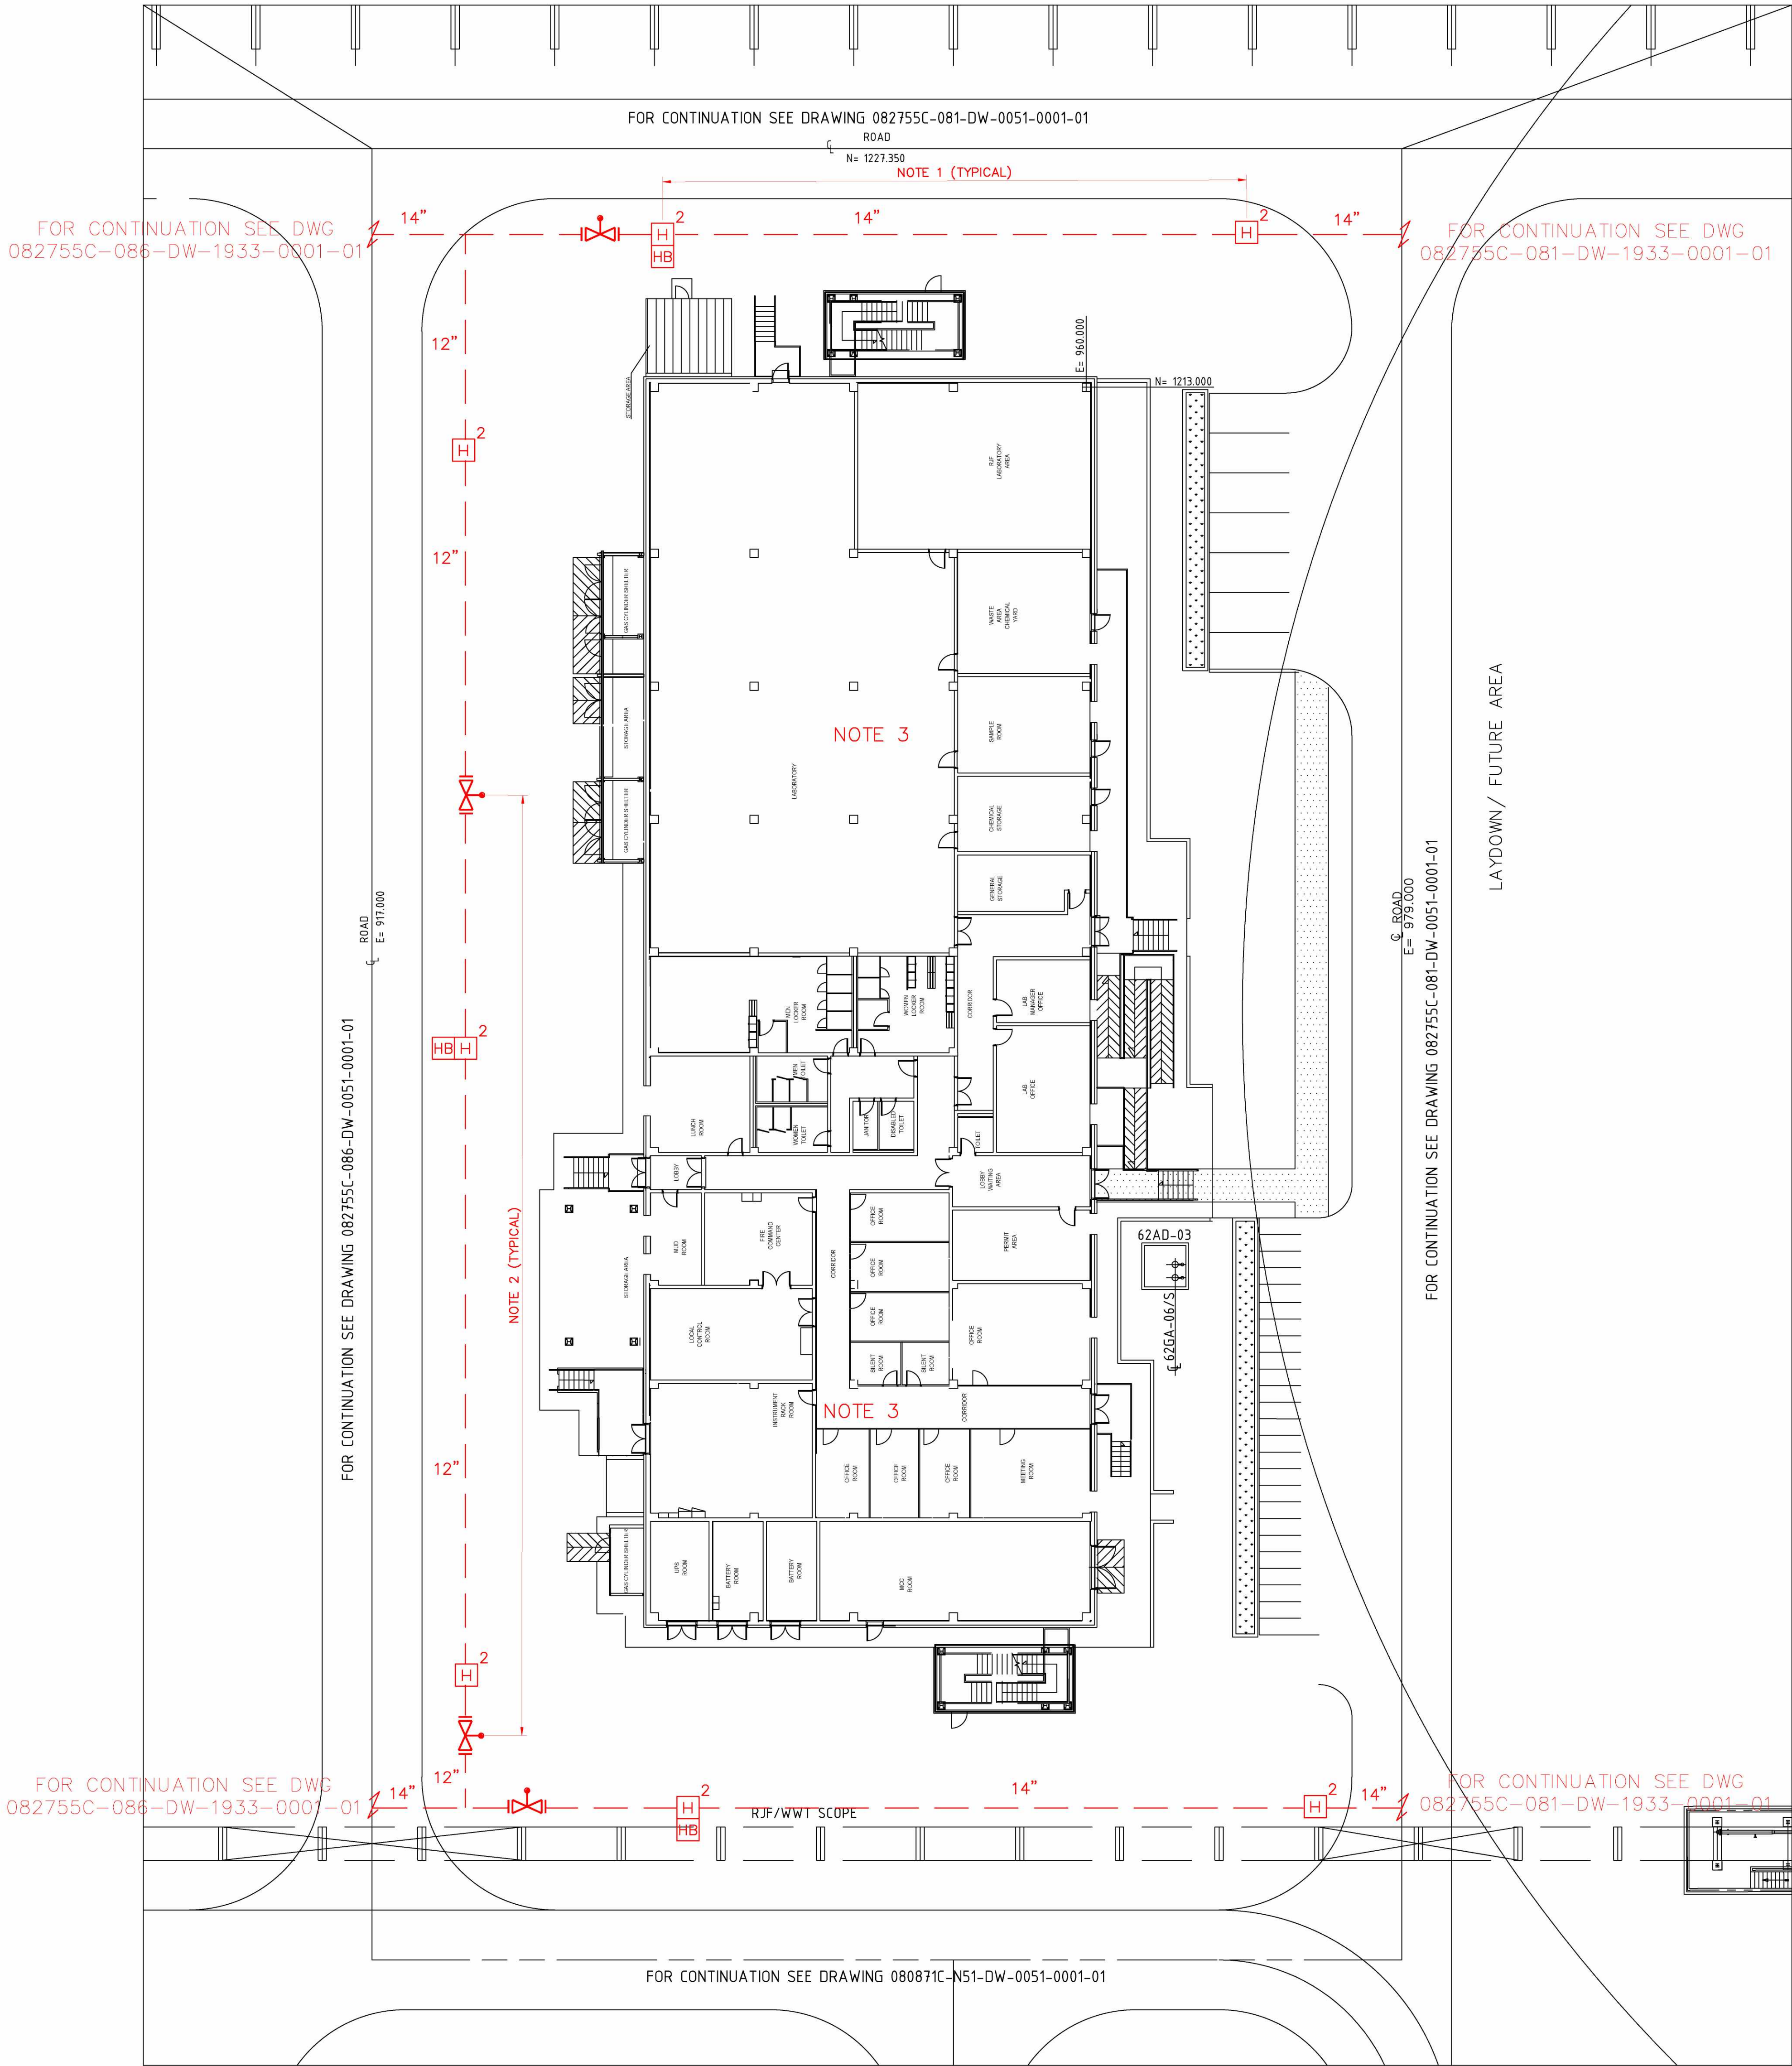

- GENERAL NOTES
- A. FOR DETAILS ON ACTIVE FIRE PROTECTION REFER TO "ACTIVE FIRE PROTECTION PHILOSOPHY" (082755C-000-JSD-1900-0001).
- B. HYDRANT CONNECTION TO FIREWATER MAIN RING IS 6".
- NOTES
1. MAXIMUM DISTANCE BETWEEN TWO HYDRANTS SHALL NOT EXCEED 40 METERS.
2. MAXIMUM DISTANCE OF PIPING BETWEEN TWO PIPS SHALL BE NO MORE THAN 60 METERS AND SUCH THAT NO MORE THAN THREE FIRE PROTECTION DEVICES (MONITORS, HYDRANTS, FIXED SPRAY SYSTEM) ARE OUT OF SERVICE.
3. FOR FIRE ACTIVE PROTECTION INFORMATION ON OPERATION BUILDING, LABORATORY AND SS-14 (MNA) REFER TO RELEVANT BUILDING DRAWING (HOLD).

SYMBOLS	DESIGNATION	QTY
	TWO WAY HYDRANT	7
	FOUR WAY HYDRANT	0
	HOSE BOX (HB)	3
	HYDRANT WITH MONITOR	0
	WATER MONITOR (WM)	0
	ELEVATED REMOTE CONTROL WATER MONITOR (EWM)	0
	REMOTE CONTROL WATER MONITOR WITH TOWER (TWM)	0
	REMOTE CONTROL FOAM-WATER MONITOR (FWM)	0
	FOAM-WATER MONITOR	0
	FOAM CONTAINER	0
	DRY RISING MAIN WITH BREACHING INLET CONNECTION (DR)	0
	HOSE REEL (HR)	0
	DELUGE VALVE (DV)	0
	POST INDICATOR VALVE (PI)	4
	FIXED SPRAY SYSTEM	0
	FIRE WATER U/G LINE	NOT APPLICABLE
	FIRE WATER A/G LINE	NOT APPLICABLE

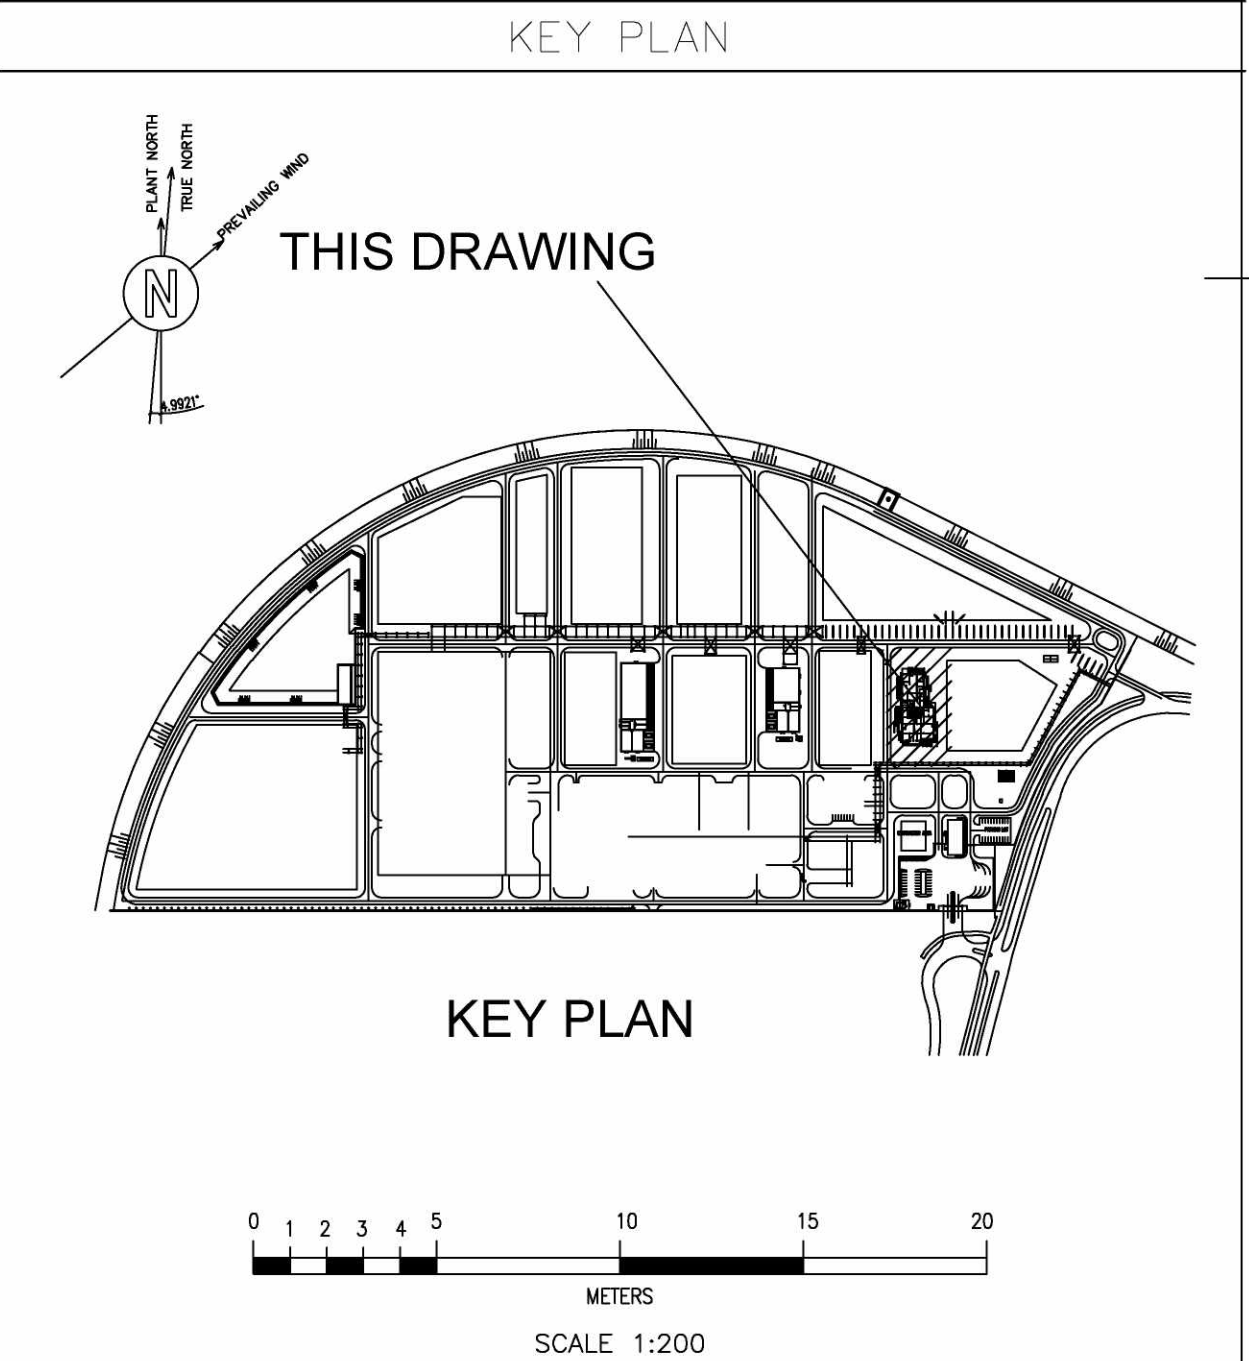

087255C-076-DW-0051-0002-01_B		076 (OP. BLDG AND LAB. MNA) - UNIT PLOT PLAN	
Drawing No		DESCRIPTION	
REFERENCE DRAWINGS			
CONFIDENTIAL			
2-9-2021	Issued for local authorities		
			
A	09/08/2021	ISSUE FOR REVIEW	C.POGGI A.TAMMARO
REV	DATE	DESCRIPTION	PREP CKD APPR/AUTH

NESTE		 TECHNIP ENERGIES						
RDCG (Rotterdam Capacity Growth) - DEFINITION PHASE								
NESTE								
DETAILED FIREFIGHTING LAYOUT - UNIT 076 (OP. BLDG AND LAB. MNA)								
Scale	Technip Drawing No			Page	Rev.			
1/200	082755C	076	DW	19	33	0002	1 of 1	A
-	Project	Unit	Doc.Type	Disc	Subj	Ser.No		
NESTE Drawing No								
-	CAD Model							

DO NOT USE AS PLOT PLAN VALID FOR FIREFIGHTING ONLY