


The present document or drawing is property of TECHNIP ITALY S.p.A. and shall not, under any circumstances, be totally or partially, directly or indirectly, transferred, reproduced, copied, disclosed or used, without its prior written consent. For any purpose and in any way other than that for which it is specifically intended or unless it is specifically authorized by written consent of TECHNIP ITALY S.p.A.

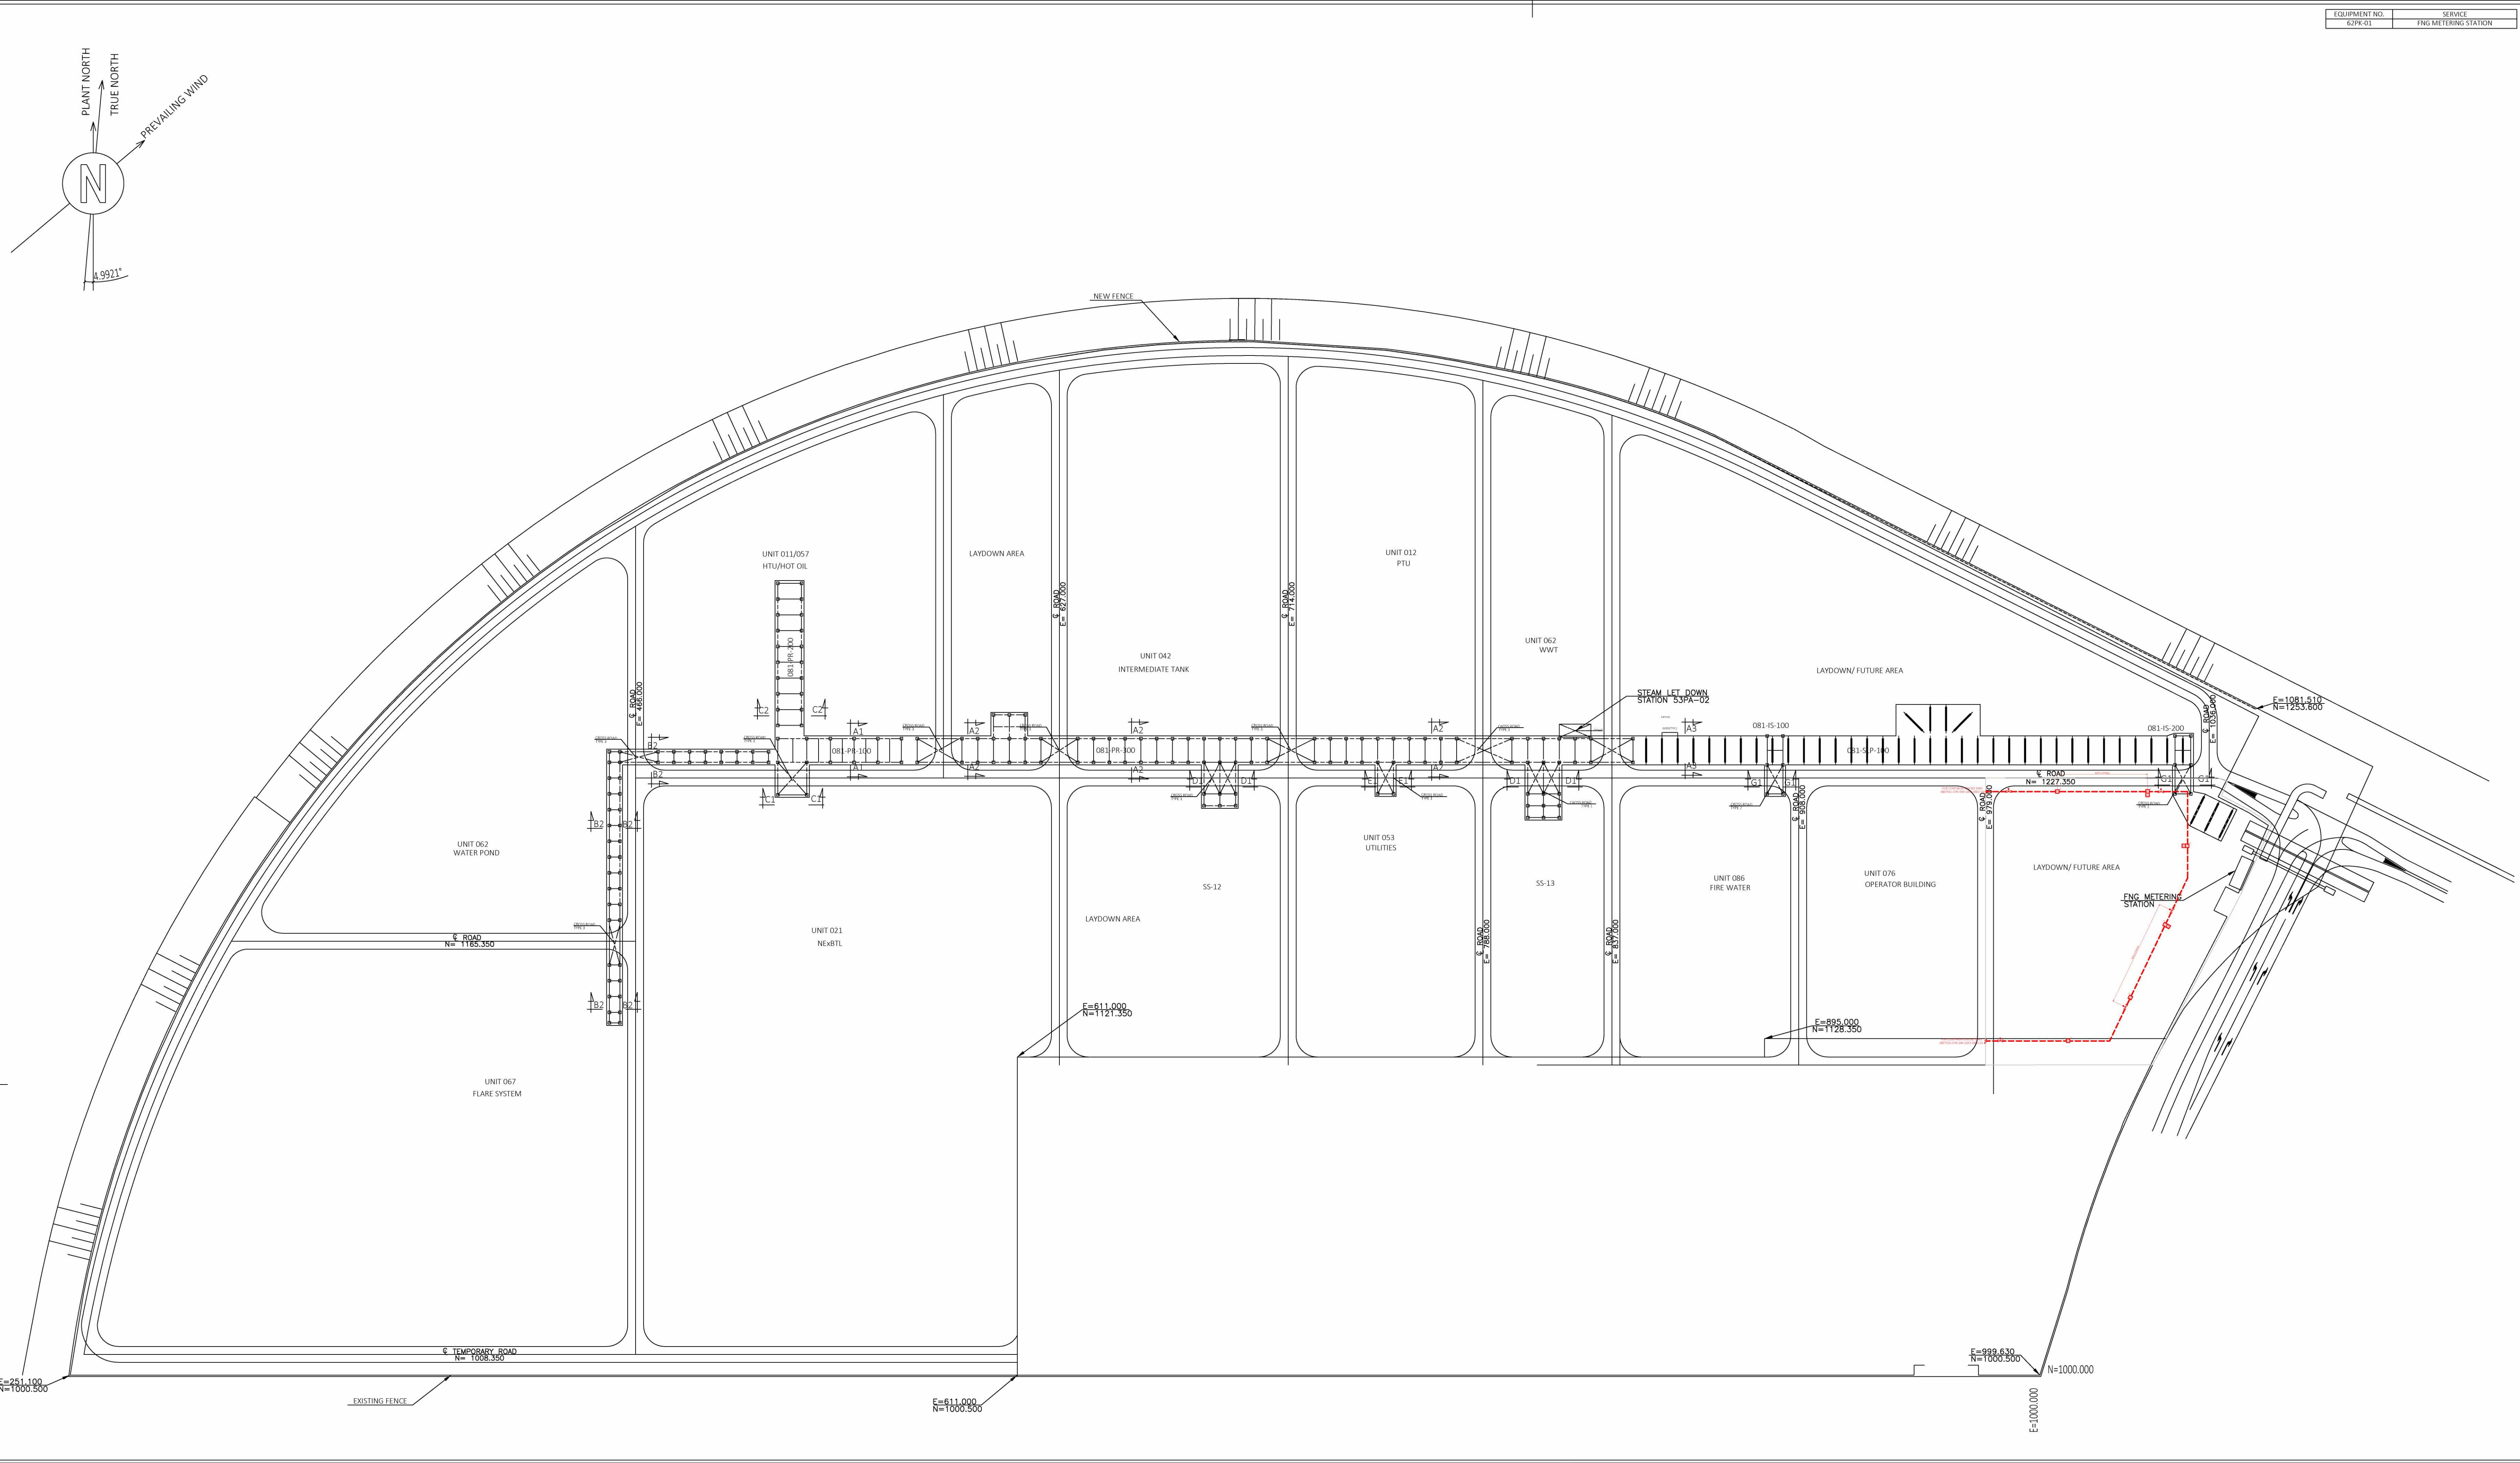


- GENERAL NOTES**
- A. FOR DETAILS ON ACTIVE FIRE PROTECTION REFER TO "ACTIVE FIRE PROTECTION PHILOSOPHY" (082755C-000-000-1900-0001).
- B. HYDRANT CONNECTION TO FIREWATER MAIN RING IS 6".
- C. PURPOSE OF THIS DRAWING IS TO SHOW FIREFIGHTING ITEMS LOCATION ON LAYDOWN/FUTURE AREA ON THE EAST SIDE OF UNIT 76 (OPERATOR BUILDING AND MNA LABORATORY).

- NOTES**
1. MAXIMUM DISTANCE BETWEEN TWO HYDRANTS SHALL NOT EXCEED 40 METERS.
2. MAXIMUM DISTANCE OF PIPING BETWEEN TWO PWS SHALL BE NO MORE THAN 60 METERS AND SUCH THAT NO MORE THAN THREE FIRE PROTECTION DEVICES (MONITORS, HYDRANTS, FIXED SPRAY SYSTEM) ARE OUT OF SERVICE.

LEGEND		
SYMBOLS	DESIGNATION	QTY
[Symbol]	TWO WAY HYDRANT	6
[Symbol]	FOUR WAY HYDRANT	0
[Symbol]	HOSE BOX (HB)	3
[Symbol]	HYDRANT WITH MONITOR	0
[Symbol]	WATER MONITOR (WM)	0
[Symbol]	ELEVATED REMOTE CONTROL WATER MONITOR (ERWM)	0
[Symbol]	REMOTE CONTROL WATER MONITOR WITH TOWER (RWMT)	0
[Symbol]	REMOTE CONTROL FOAM-WATER MONITOR (FWM)	0
[Symbol]	FOAM-WATER MONITOR	0
[Symbol]	FOAM CONTAINER	0
[Symbol]	DRY RISING MAIN WITH BREECHING INLET CONNECTION (DR)	0
[Symbol]	HOSE REEL (HR)	0
[Symbol]	DELUGE VALVE (DV)	0
[Symbol]	POST INDICATOR VALVE (PI)	5
[Symbol]	FIXED SPRAY SYSTEM	0
[Symbol]	FIRE WATER U/G LINE	NOT APPLICABLE
[Symbol]	FIRE WATER A/G LINE	NOT APPLICABLE

DO NOT USE AS PLOT PLAN VALID FOR FIREFIGHTING ONLY

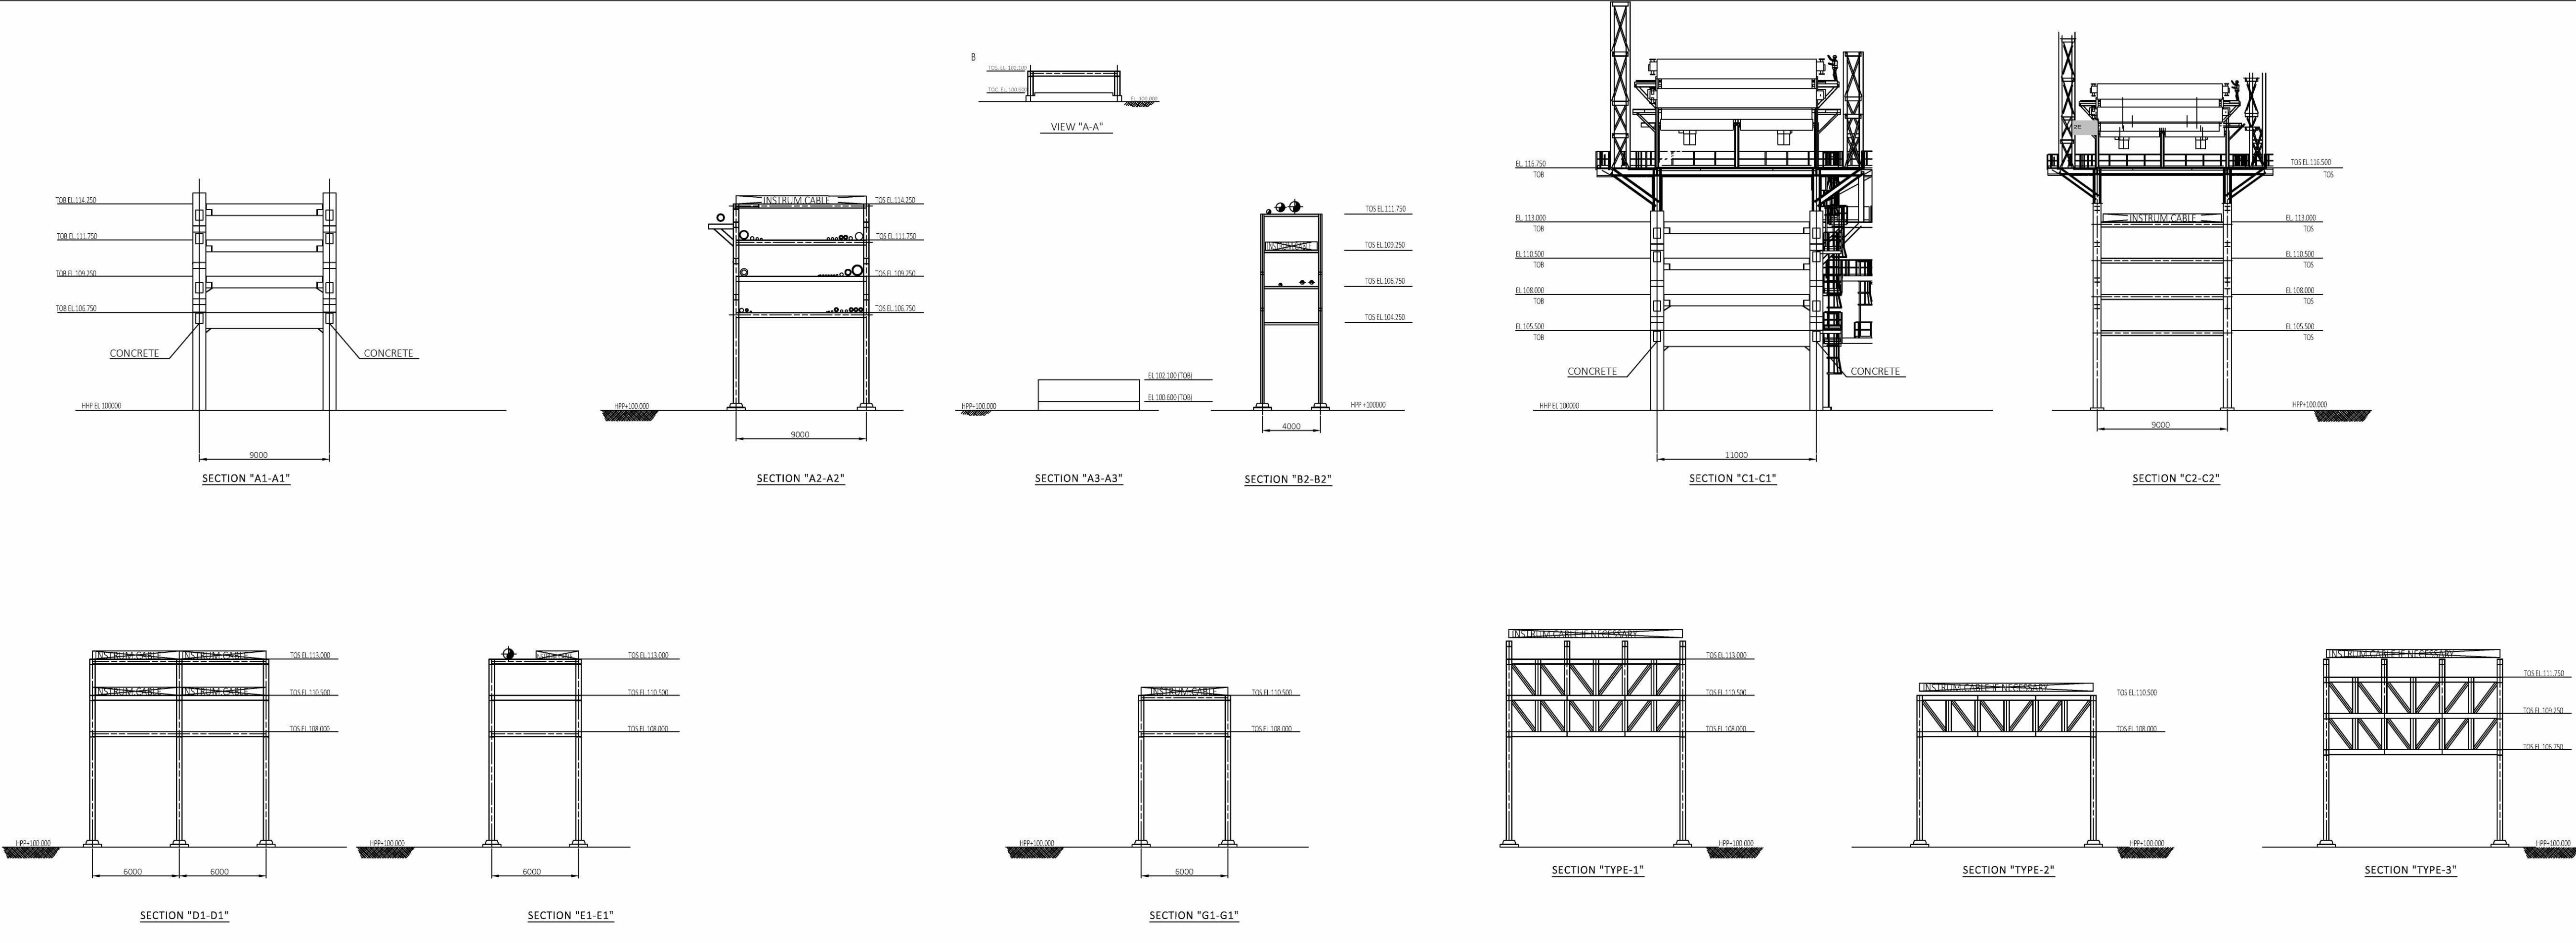

082755C-081-DW-0051-0001-01_B		UNIT-081 (INTERCONNECTING MNA) UNIT PLOT PLAN			
Drawing No	DESCRIPTION				
REFERENCE DRAWINGS					
CONFIDENTIAL					
2-9-2021 issued for local authorities					
A	07/06/2021	ISSUE FOR REVIEW	C.POGGI A.TAMBURO (NEW LOGO & LOGO)		
REV	DATE	DESCRIPTION	PREP OLD APPR/AUTH		
NESTE TEN TECHNIP ENERGIES					
RDCG (Rotterdam Capacity Growth) - DEFINITION PHASE					
NESTE					
DETAILED FIREFIGHTING LAYOUT - UNIT 081					
Scale	Technip Drawing No			Page	Rev.
1/250	082755C	081 DW 19 33 0001	1of1	A	
Project Unit Doc.Type Disc Subj Ser No					
NESTE Drawing No					
CAD Model					

CAD Model 082755C-081-DW-1933-0001-1_A.dwg