





GENERAL NOTES	
A.	FOR DETAILS ON FIRE EXTINGUISHER REFER TO ACTIVE FIRE PROTECTION PHILOSOPHY (DOC N° 082755C-000-JSD-1900-001).
B.	FOR DETAILS ON SAFETY SHOWER AND EYE WASH STATION REFER TO HSE DESIGN CRITERIA (DOC N° 082755C-000-JSD-1900-003)

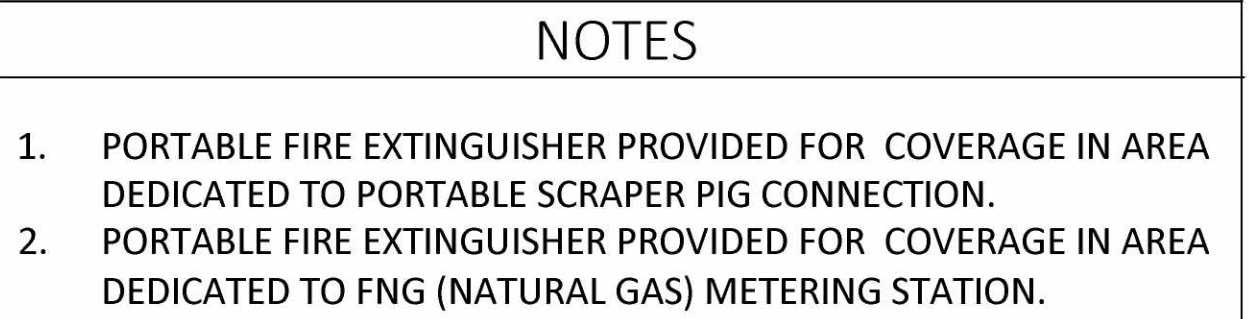

SYMBOLS	DESIGNATION	QTY
	SAFETY SHOWER & EYE WASH STATION (SS)	1
	PORTABLE EXTINGUISHER 12 kg	6
	WHEELED EXTINGUISHER 50 kg	2
	STEAM LANCE	0

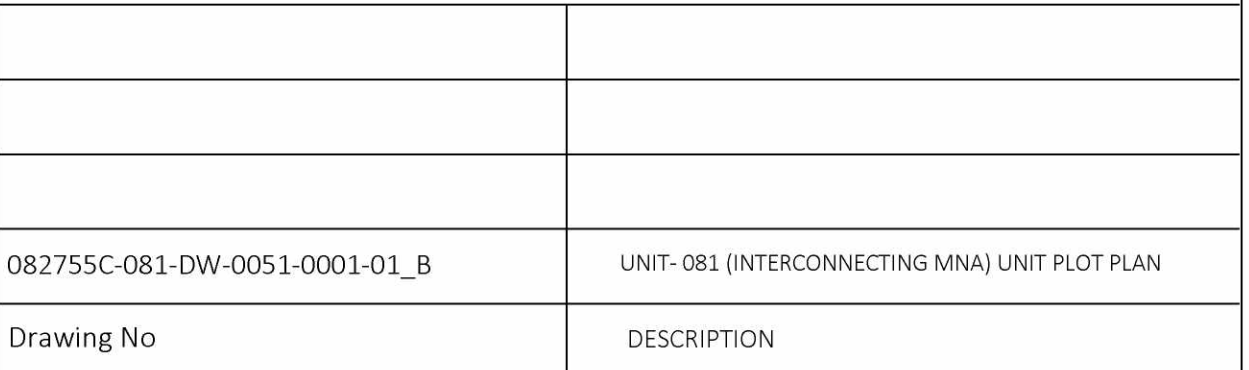





RODCG (Rotterdam Capacity Growth) - DEFINITION PHASE

NESTE

SAFETY EQUIPMENT AND PERSONNEL PROTECTION

EQUIPMENT LAYOUT - UNIT 081

Scale	Techniq Drawing No	Page	Rev.
1/250	082755C Project	Unit DW	19 Disc
	081 Doc.Type	33 Subj	0011 Ser.No
		1of1	A

NESTE Drawing No



CAD Model