


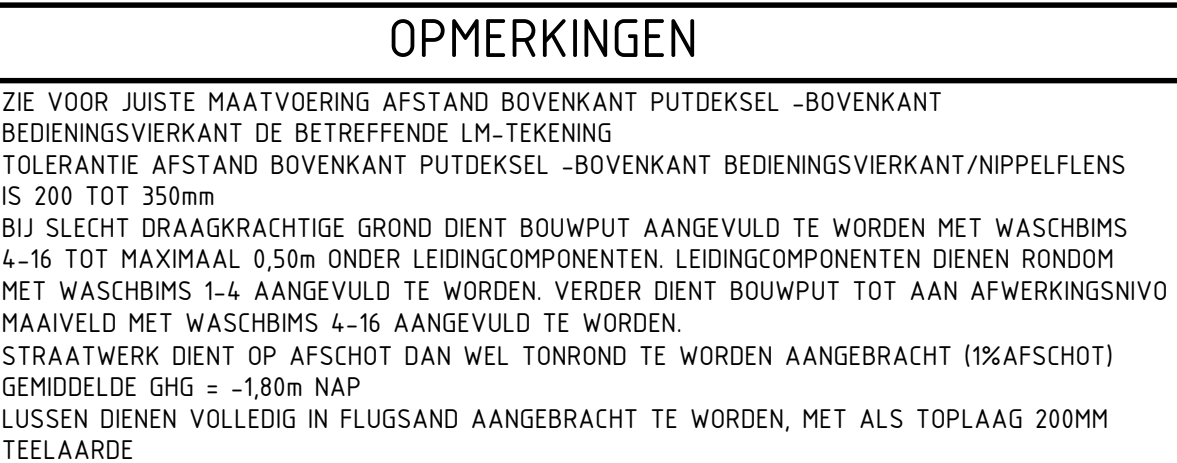

Datum: 11-04-2016
X: 116293,49 Y: 453094,40 Z: -1,591 m NAP

0 berm

1 Klei, matig siltig, sterk humeus, geen olie-water reactie, donkerbruin, Edelmanboor

50

209

2 Veen, sterk kleiig, geen olie-water reactie, donkerbruin, Edelmanboor

100

3

150

4


200

359

DCVG-MEETPUT
PUTJES MOETEN GEPLAATSDWORDEN IN RECHTLIJNIG RASTER.
MAXIMALE AFSTAND TUSSEN TWEË PUTJES OVER HET RASTER IS
MAXIMAAL 1500mm. WANNEER EEN STRAATPOT IN HET RASTER VALT DAN
TELT DEZE BINNENDIAMETER SCHUTBUIS MEE ALS EEN PUTJE. HET RASTER
MOET ZO ECONOMISCH MOGELIJK GEPROJECTEERD WORDEN.

[illegible]

TITEL										Mod. 1	
CONSTRUCTIE TEKENING VERHARDING											
AFSLUITSTATION S-6249											
DN300 LEIDING S.P. UTRECHT S.P. GOUDA											
STATUS											
TEKENING DOOR		AFD.		PAG.		© 2020		N.V. NEDERLANDSE GASUNIE			
K.MOS		RE		PAG.		OMSCHRIJVING WILZIGING		GETEKEND BIJ			
GECONTROLEERD DOOR T.SELDERBEEK		AFD.		RE				RE			
VOOR AANDEK						FORM.		SCHAAL		DATUM BIJ WILZIGING	
J.K.KLEINBEKMAN		AFD.		GU		FARMA		150		25-02-2020	
CATEGORIE		VAKGEBIED		TEX. SOORT		B & O		NUMMER			
L		4		5		N				WILZ. NEE	
PROJECTNUMMER		SUBLOCATIE/GEBOUW CODE		A1		W-501-01-CT-030-1-A18				0	
gasunie											

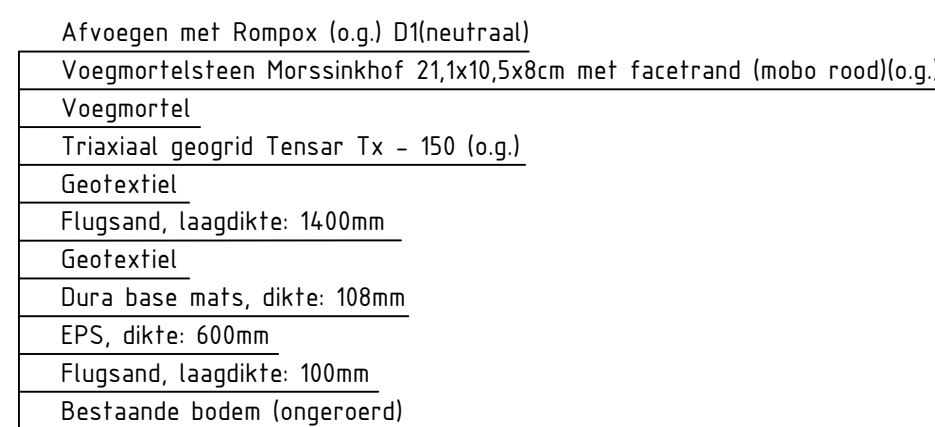

Beton opsluitband RWS 5/20x20x100,
incl.90 graden ronde hoekstukken
Opsluitband rondom in stampbeton stellen
Aanvullen met omgevings eigen grond

Dura base mats, dikte: 108mm
EPS, dikte: 600mm
Flugsand, laagdikte: 100mm
Bestaande bodem (ongeroid)

Houten damwand
Geotextiel
Watergang

DOORSNEDEN B-B

The diagram illustrates a cross-section of a retaining wall system. At the top, there's a concrete tie beam (Beton opsluitband) with dimensions 5/20x20x100, featuring 90-degree rounded corners. This beam is surrounded by concrete (stampbeton). Below the tie beam, there are three circular elements, likely pipes or conduits, each with a diameter of 200mm. The entire assembly is supported by a wooden retaining wall (Houten damwand) on the right side. The ground level is marked as existing ground (Bestaande bodem), which is ungraded (ongeroid). The foundation includes Dura base mats (108mm thick) and EPS insulation (600mm thick). A layer of Flugsand (100mm thick) is also present. Geotextile is used below the sand layer. A water channel (Watergang) is located at the bottom right. Various dimensions are provided: horizontal distances of 1110, 500, 300, 1878, 128, 200, and 818; vertical distances of -1.24, -2.08, and -2.08; and a slope of 1:3 on the left side.

Afvoegen met Rempox (o.g.) D1(neutraal)

Voegmortelsteen Meressinkhof 21,1x10,5x8cm met facetrand (mobo rood)(o.g.)

Voegmortel, laagdikte: 100mm

Triaxiaal geogrid Tensar Tx - 150 (o.g.)

Geotextiel

Flugsand, laagdikte: 1400mm

Geotextiel

Dura base mats, dikte: 108mm

EPS, dikte: 600mm

Flugsand, laagdikte: 100mm

Bestaande bodem (oingeroerd)

