
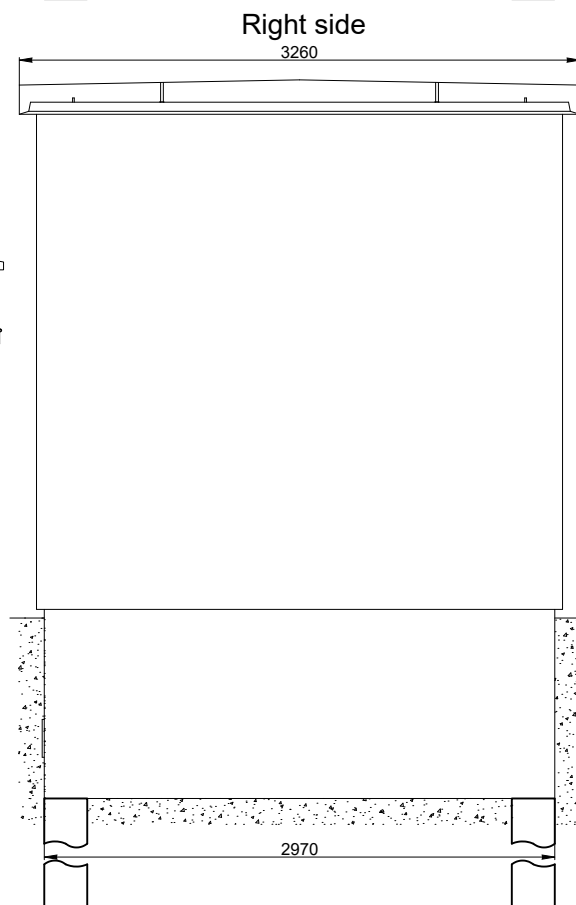
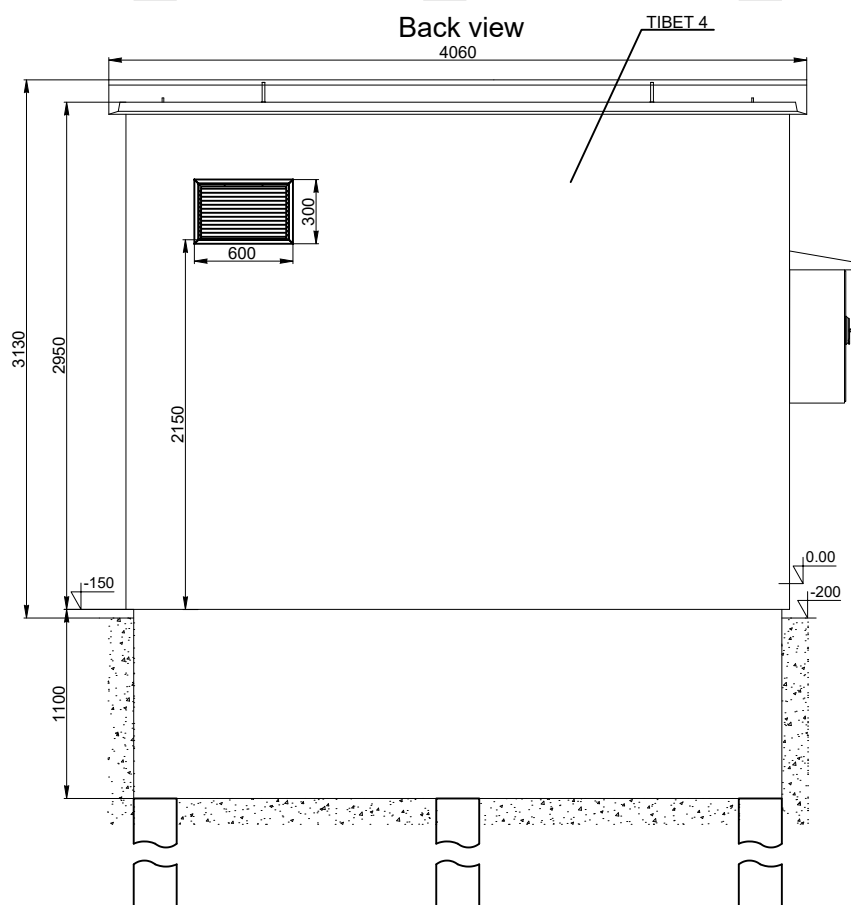
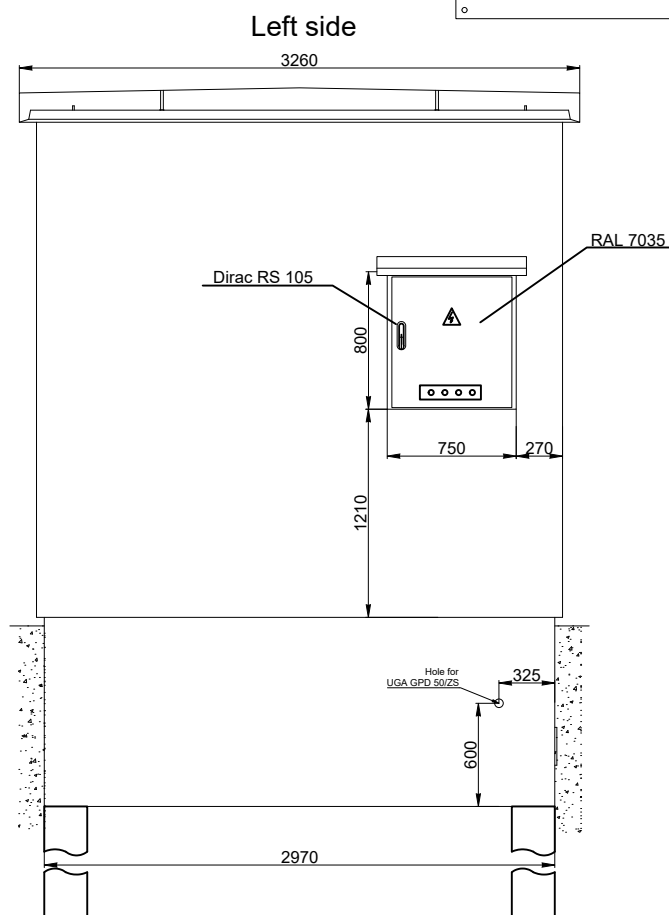
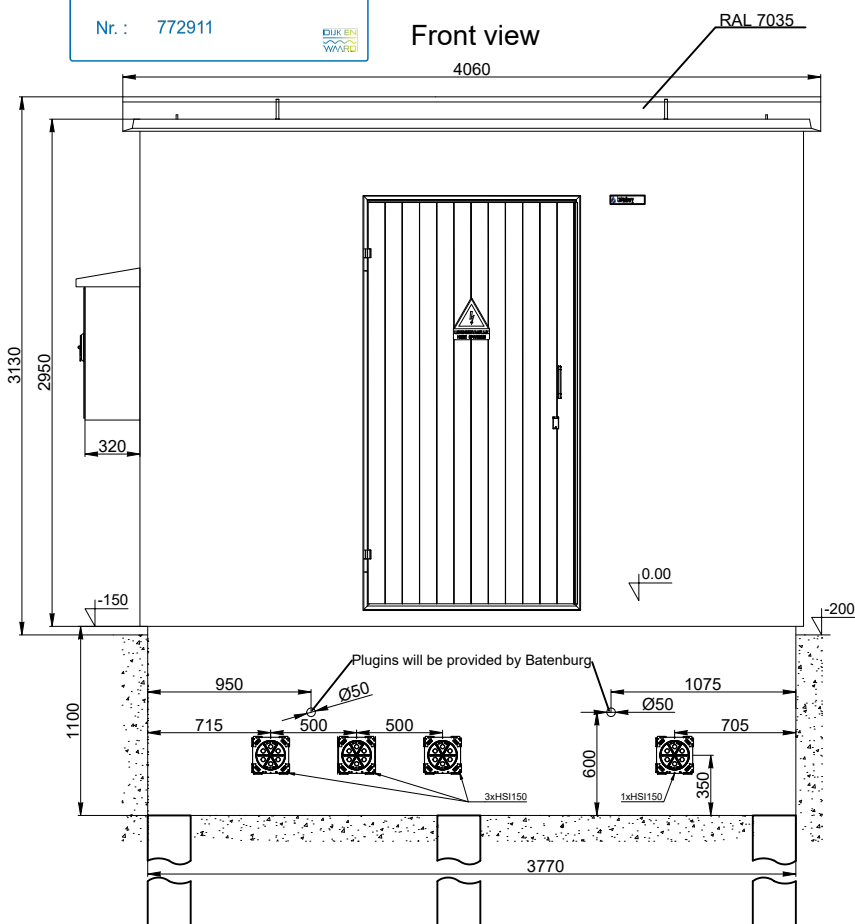



Nr. : 772911




Internal arc fault classification (IAC) tested is AB 20kA / 1s

Uwaga:

Uwaga:
 Ściany wewnętrzne z gładkim wykończeniem w kolorze RAL 9010

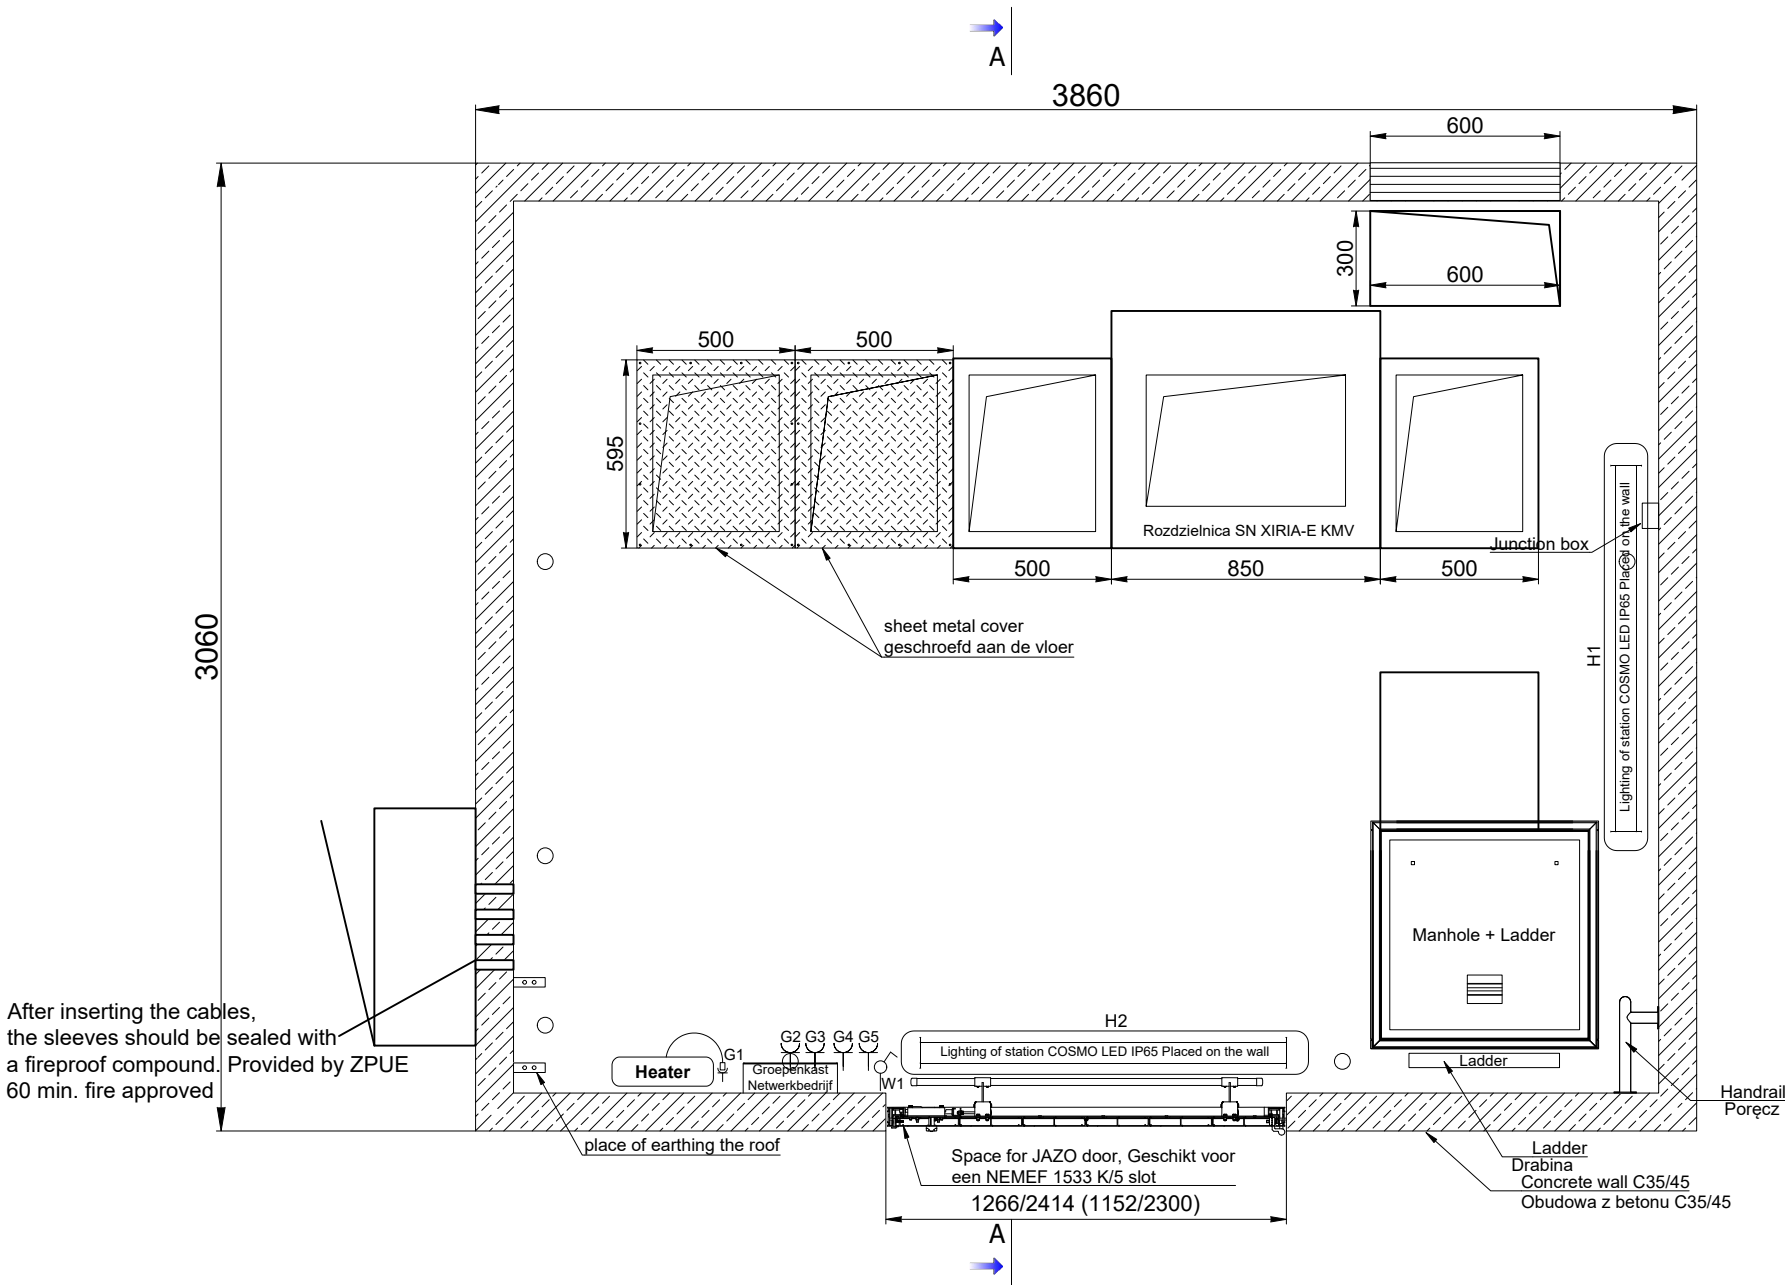

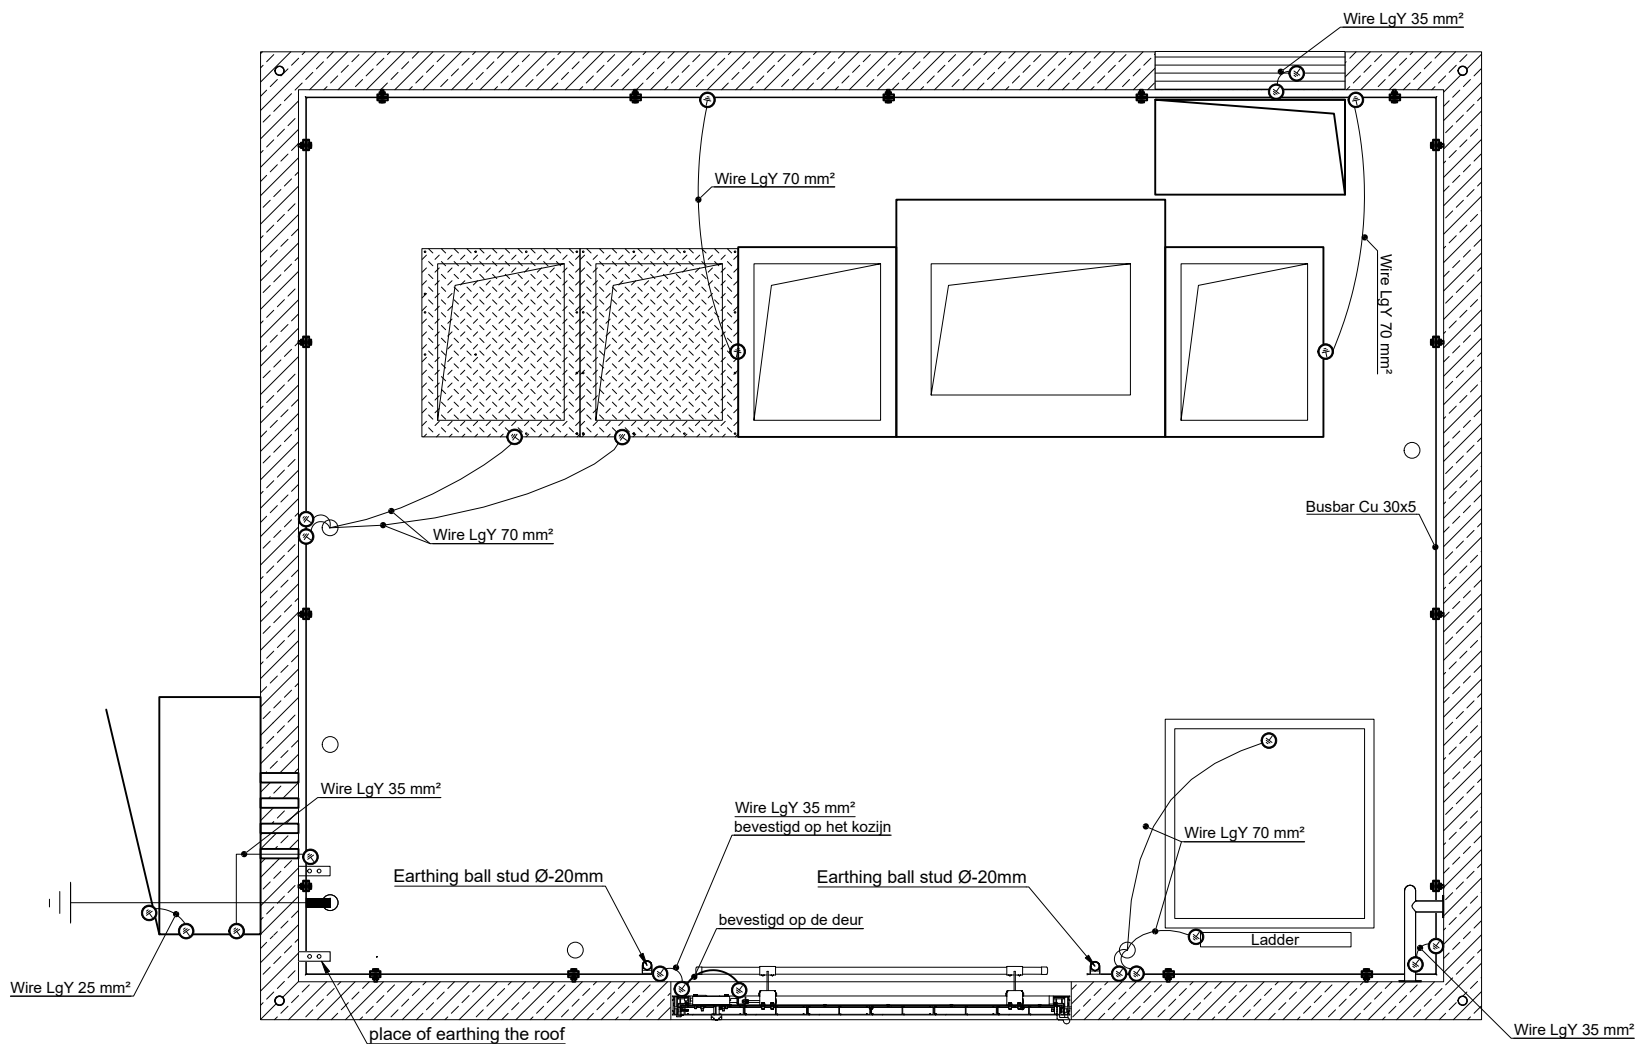


Roof without earthing.
Earthing rail at a height of 40 cm above the floor



Order	Z-2022-05724.0001
Commission	7-2022-08359
Code number	WA2-26-000-0015
Type	MRw-b2pp

Customer:  DUURZAME ENERGIE
Name: PV park Athon Heerhugowaard

Modification	C	Rak A. 1.09.2022	Quantity: 1
Designed		Adrian Rak	Scale: 1:25
Checked		Andrzej Klapa	Page: 3/8
Date		28.06.2022	

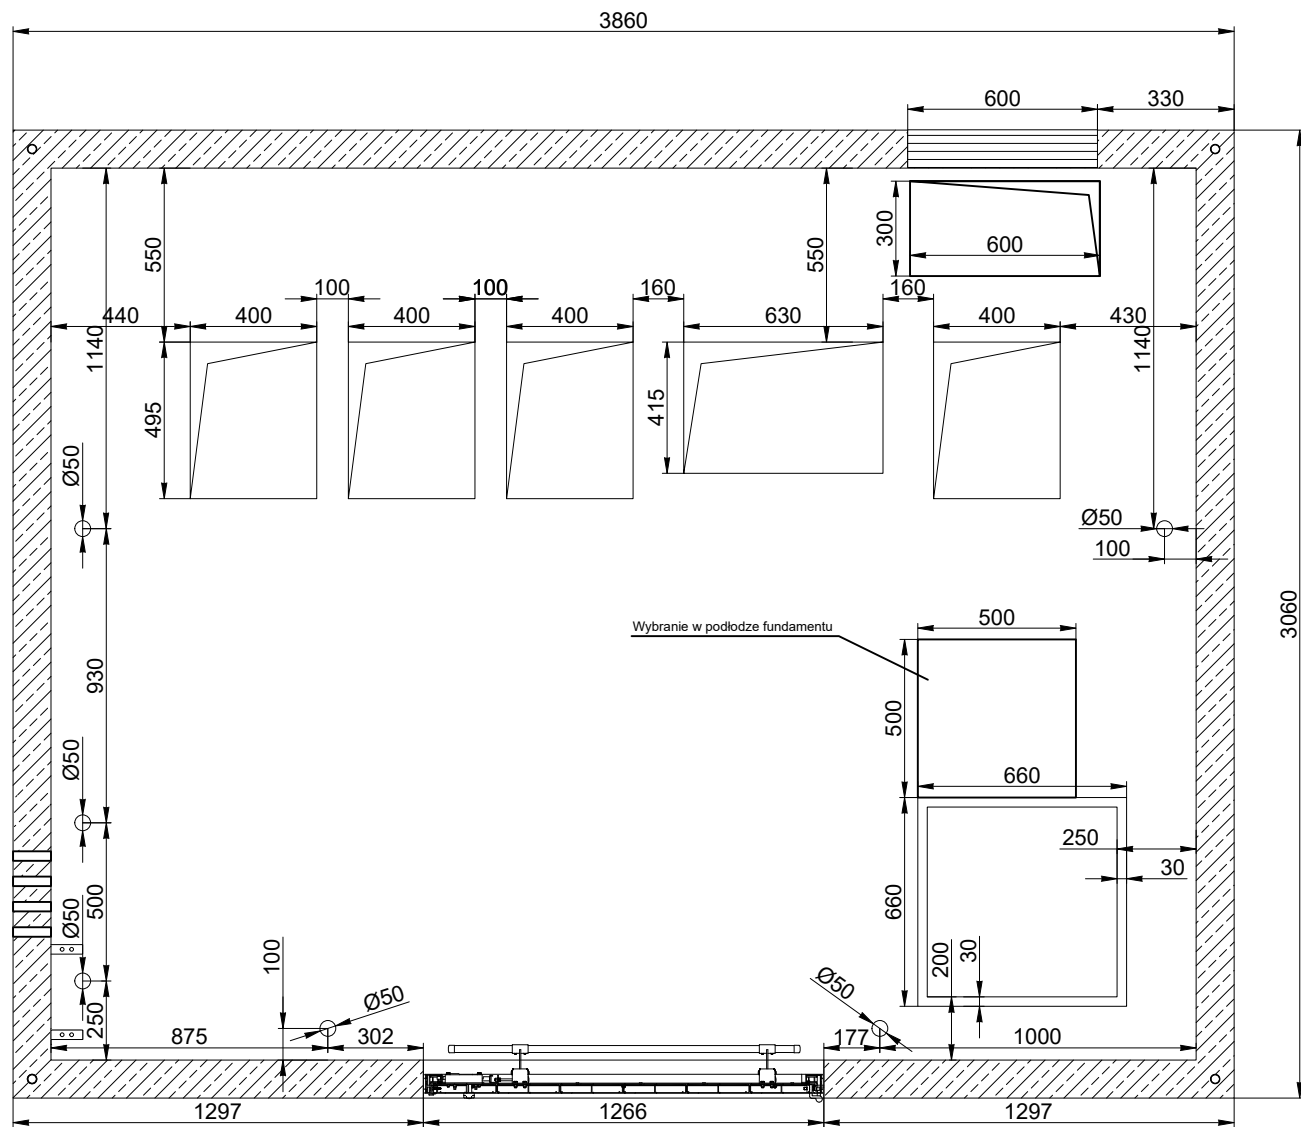


Order	Z-2022-05724.0001
Commission	7-2022-08359
Code number	WA2-26-000-0015
Type	MRw-b2pp

Customer:	 IX Zon DUURZAME ENERGIE
Name:	PV park Athon Heerhugowaard

Modification	C	Rak A. 1.09.2022	Quantity:
Designed	Adrian Rak		1
Checked	Andrzej Klapa		Scale:
Date	28.06.2022		1:25
			Page:
			4/8

A-A

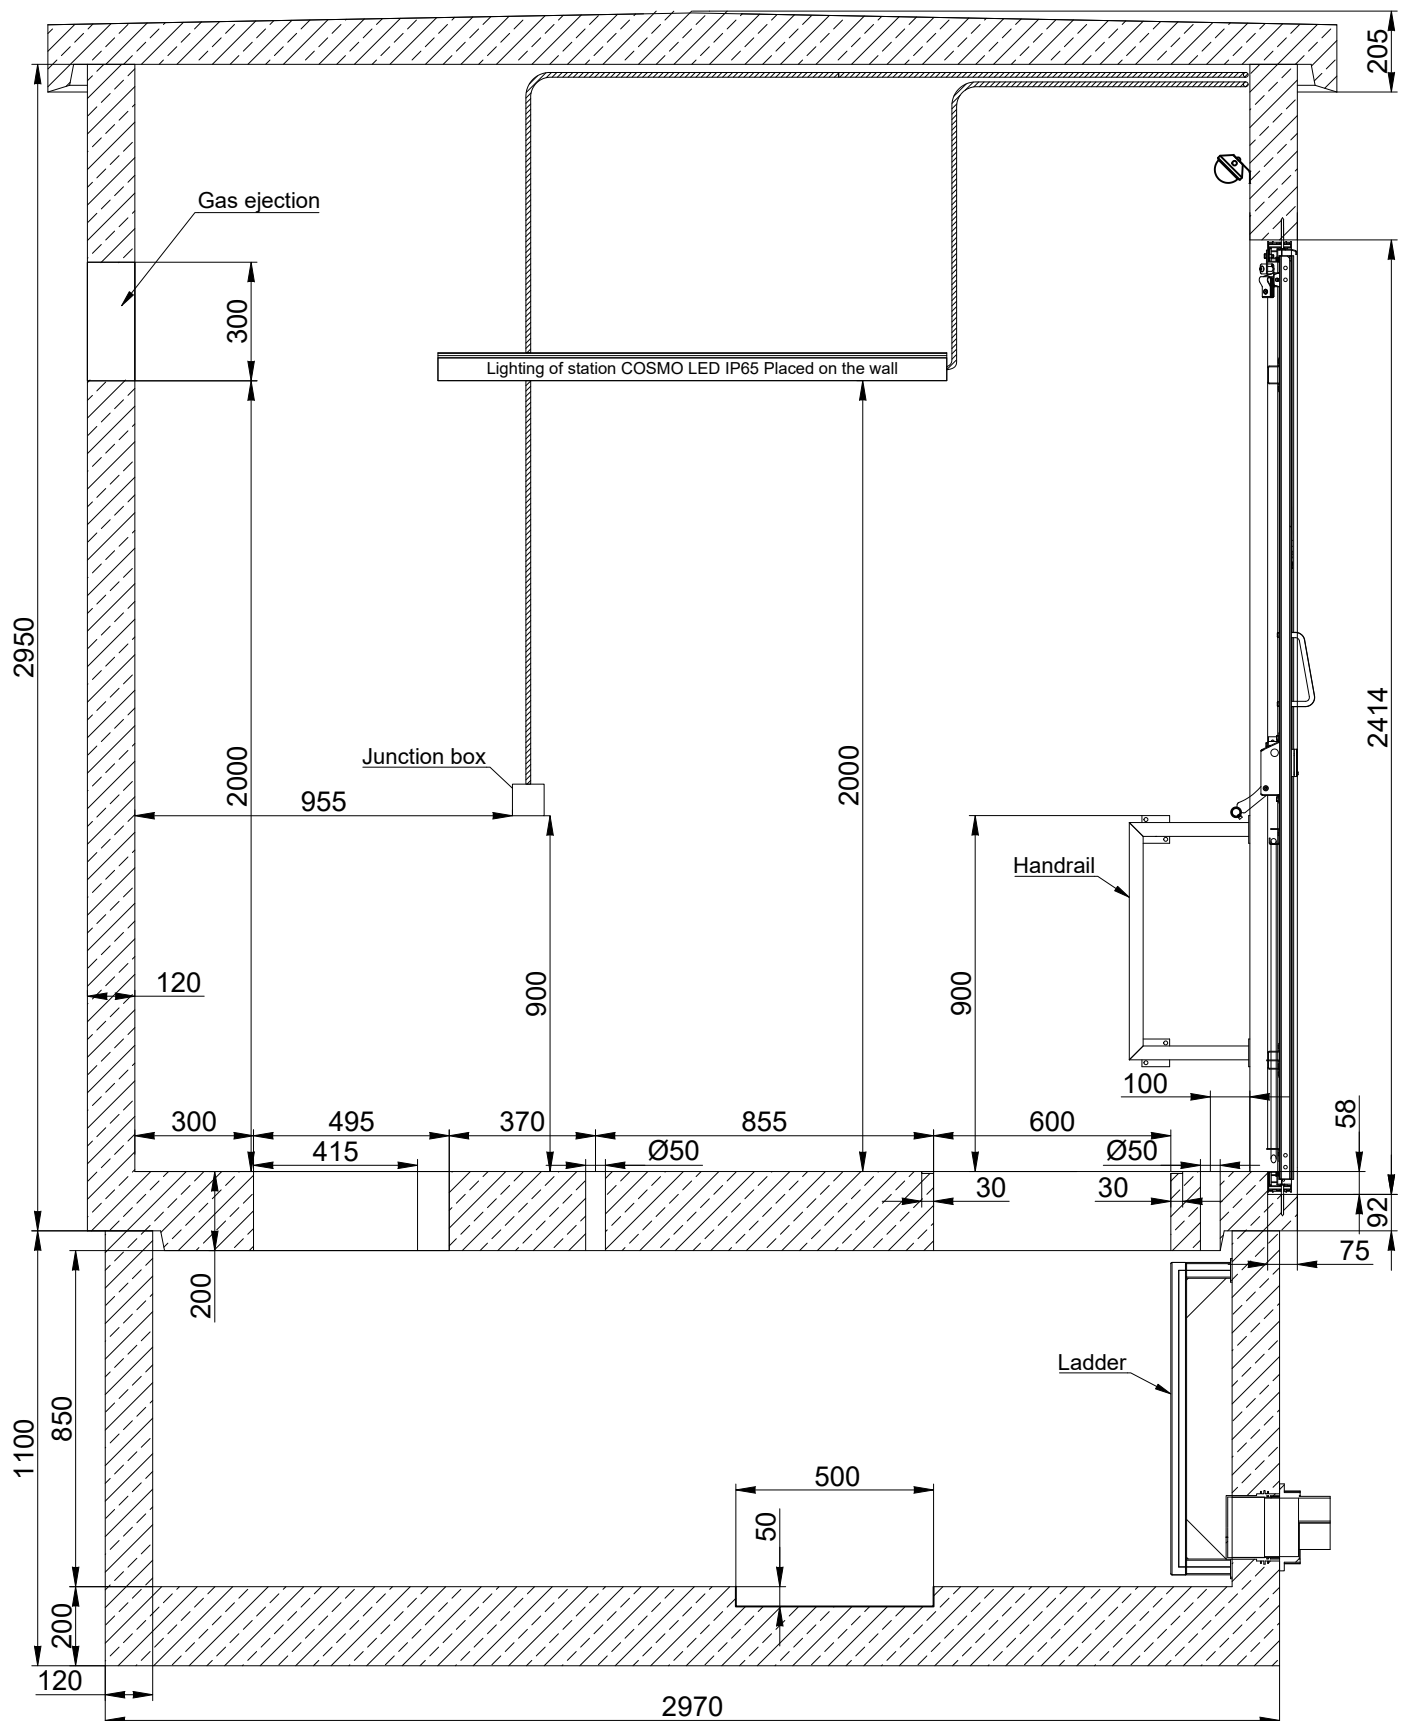






Customer:	 IX Zon DUURZAME ENERGIE
Name:	PV park Athon Heerhugowaard



Modification		Quantity:
Designed	Adrian Rak	1
Checked	Andrzej Klapa	Scale: 1:25
Date	28.06.2022	Page: 6/8

Space for JAZO door

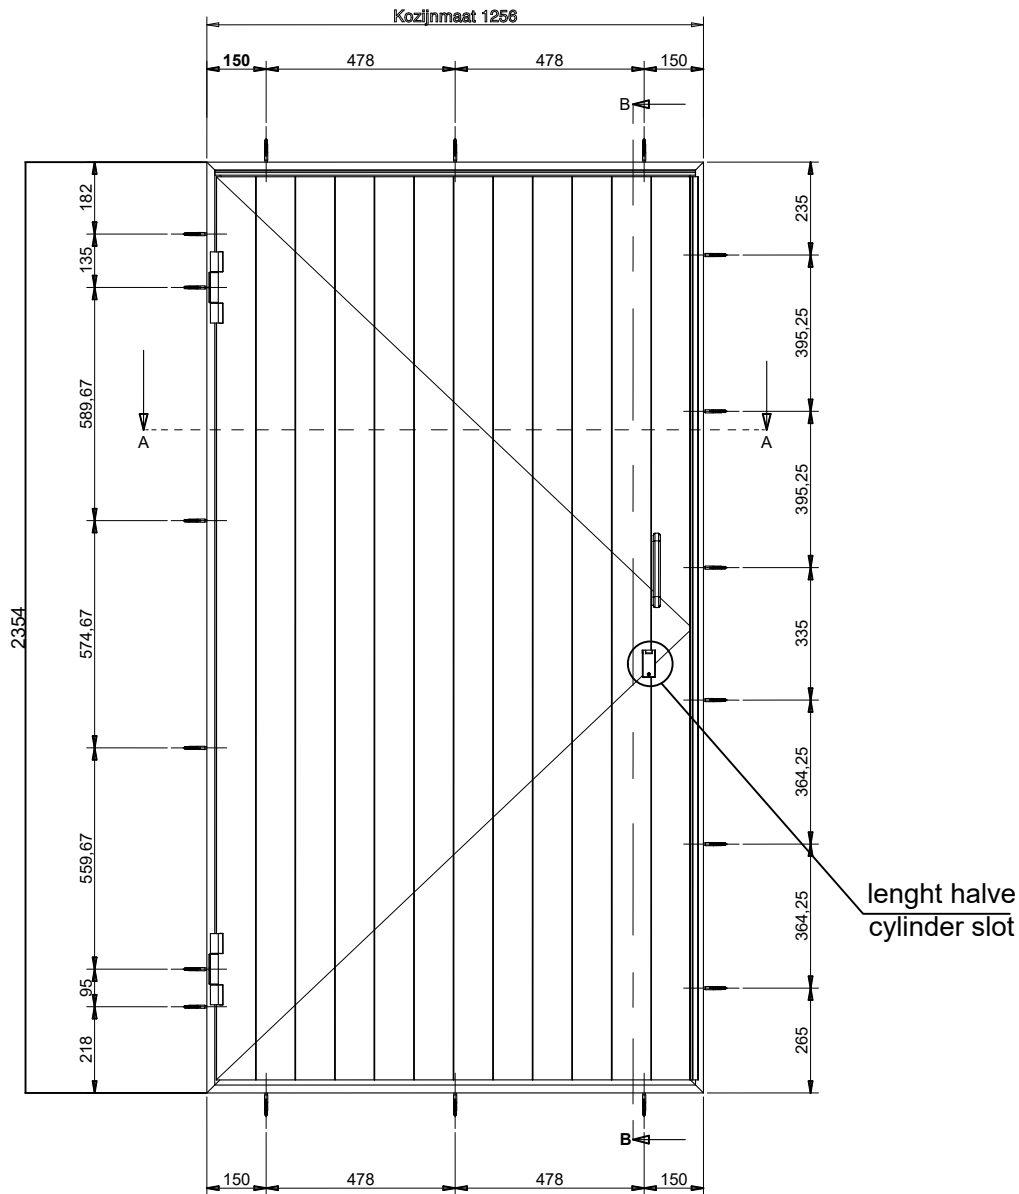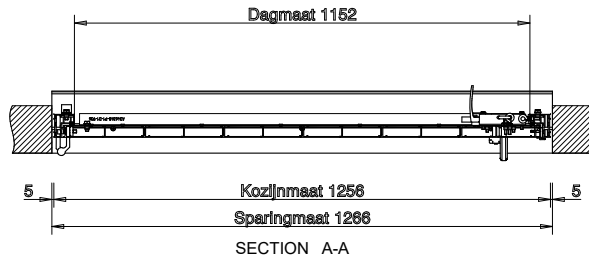

SECTION B-B

Groepenkast
Netwerkbetrijf

Lgy 10mm²

F1
FAZ/2
D25

F1.1
PKNM-1N
B16A
0,03A

F1.2
PKNM-1N
B16A
0,03A

F1.3
PKNM-1N
B16A
0,03A

F1.4
PKNM-1N
B16A
0,03A

F1.5
FAZ/2
D20

G1
16A
230V

G2/G3
16A
230V

G4
16A
230V

G5
16A
230V

W1
H1-H2
Lighting of station
COSMO LED IP65
Placed on the wall

Heater 1,5 kW

Junction box

L
N
PE

F1	F1.1:2	F1.1:1
	2	4
	1	3
L		N

